



Português (PT)

2

English (EN)

56

Español (ES)

110

Installation, Operation and Maintenance Manual of Electric Motors for Use in Explosive Atmospheres

This manual provides information about WEG induction motors fitted with squirrel cage, permanent magnets or hybrid rotors, low, medium and high voltage, in frame size IEC 56 to 630 and NEMA 42 to 9606/10 for use in explosive atmospheres with the following types of protection:

- Equipment protection by increased safety – “Ex eb” and “Ex ec”
- Equipment protection by flameproof enclosures – “Ex db” and “Ex db eb”
- Equipment dust ignition protection by enclosure – “Ex tb” and “Ex tc”
- Equipment protection for use in Class I, Division 1
- Equipment protection for use in Class I, Division 2

These motors meet the following standards, if applicable:

- NBR 17094-1: Máquinas Elétricas Girantes - Motores de Indução - Parte 1: Trifásicos
- NBR 17094-2: Máquinas Elétricas Girantes - Motores de Indução - Parte 2: Monofásicos
- IEC 60034-1: Rotating Electrical Machines - Part 1: Rating and Performance
- NEMA MG 1: Motors and Generators
- EN / IEC 60079-0: Explosive Atmospheres – Part 0: Equipment - General Requirements
- NBR IEC 60079-0: Atmosferas Explosivas - Equipamentos - Requisitos Gerais
- EN / IEC 60079-1: Explosive Atmospheres – Part 1: Equipment protection by flameproof enclosures “d”
- NBR IEC 60079-1: Proteção de Equipamento por Invólucro à Prova de Explosão “d”
- EN / IEC 60079-7: Explosive Atmospheres – Part 7: Equipment protection by increased safety “e”
- NBR IEC 60079-7: Proteção de Equipamentos por Segurança Aumentada “e”
- EN / IEC 60079-31: Explosive Atmospheres – Part 31: Equipment dust ignition protection by enclosure “t”
- NBR IEC 60079-31 - Atmosferas Explosivas Parte 31: Proteção de Equipamentos Contra Ignição de Poeira por Invólucros “t”
- UL 674 – Electric Motors and Generators for Use in Division 1 Hazardous (Classified) Locations
- CSA C22.2 N°145 – Motors and Generators for Use in Hazardous Locations
- CSA C22.2 N°30 - Explosion-Proof Enclosures for Use in Class I Hazardous Locations
- CSA C22.2 N°213 - Non-Incendive Electrical Equipment for Use in Class I, Division 2 Hazardous Locations

Information about the classification of areas and safety requirements to be considered during equipment repair, overhaul and reclamation, when applicable, can be found in the following standards:

- EN / IEC 60079-10-1: Classification of areas - Explosive gas atmospheres
- ABNT NBR IEC 60079-10-1: Classificação de áreas - Atmosferas explosivas de gás
- EN/ IEC 60079-10-2: Classification of areas - Combustible dust atmospheres
- NBR IEC 60079-10-20 - Classificação de áreas - Atmosferas de poeiras explosivas
- EN / IEC 60079-14: Electrical installations design, selection and erection
- NBR IEC 60079-14: Projeto, Seleção e Montagem de Instalações Elétricas
- EN / IEC 60079-17: Electrical installations inspection and maintenance
- NBR IEC 60079-17: Inspeção e Manutenção de Instalações Elétricas
- EN / IEC 60079-19: Equipment repair, overhaul and reclamation
- NBR IEC 60079-19: Reparo, Revisão e Recuperação de Equipamentos

If you have any questions regarding this manual, please contact WEG branch.



TABLE OF CONTENTS

1. TERMINOLOGY	60
2. INITIAL RECOMMENDATIONS	63
2.1. WARNING SYMBOL.....	64
2.2. RECEIVING INSPECTION	64
2.3. NAMEPLATES.....	65
3. SAFETY INSTRUCTIONS	68
4. HANDLING AND TRANSPORT	68
4.1. LIFTING.....	69
4.1.1. Horizontal motors with one eyebolt.....	69
4.1.2. Horizontal motor with two eyebolts	69
4.1.3. Vertical Motors	71
4.1.3.1. Procedures to place W22 motors in the vertical position	71
4.1.3.2. Procedures to place HGF, W50 and W51 HD motors in the vertical position.....	72
4.2 PROCEDURES TO PLACE W22 VERTICAL MOUNT MOTORS IN HORIZONTAL POSITION	73
5. STORAGE	75
5.1. EXPOSED MACHINED SURFACES	75
5.2. STORAGE.....	75
5.3 BEARINGS.....	76
5.3.1 Grease lubricated bearings.....	76
5.3.2 Oil Lubricated bearings.....	76
5.3.3 Oil Mist lubricated bearings.....	77
5.3.4 Sleeve Bearing	77
5.4. INSULATION RESISTANCE.....	77
5.4.1. Insulation resistance measurement.....	77
6. INSTALLATION	79
6.1. FOUNDATIONS.....	80
6.2. MOTOR MOUNTING.....	82
6.2.1. Foot mounted motors	82
6.2.2. Flange mounted motors.....	82
6.2.3. Pad mounted motors.....	83
6.3. BALANCING.....	83
6.4. COUPLINGS.....	83
6.4.1. Direct coupling	84
6.4.2. Gearbox coupling.....	84
6.4.3. Pulley and belt coupling	84
6.4.4. Coupling of sleeve bearing motors	84

6.5. LEVELING.....	85
6.6. ALIGNMENT	85
6.7. CONNECTION OF OIL LUBRICATED OR OIL MIST LUBRICATED MOTORS	86
6.8. CONNECTION OF THE COOLING WATER SYSTEM	86
6.9. ELECTRICAL CONNECTION	86
6.10. CONNECTION OF THE THERMAL PROTECTION DEVICES	90
6.11. RESISTANCE TEMPERATURE DETECTORS (PT-100)	91
6.12. CONNECTION OF THE SPACE HEATERS	93
6.13. STARTING METHODS.....	93
6.14. MOTORS DRIVEN BY FREQUENCY INVERTER.....	94
6.14.1. Use of dV/dt filter	94
6.14.1.1. Motor with enameled round wire	94
6.14.1.2. Motor with prewound coils	95
6.14.2. Bearing insulation	95
6.14.3. Switching Frequency.....	95
6.14.4. Mechanical speed limitation	96
7. COMMISSIONING	96
7.1. INITIAL START-UP	96
7.2. OPERATING CONDITIONS	98
7.2.1.Limits of vibration	100
8. MAINTENANCE	100
8.1. GENERAL INSPECTION	100
8.2. LUBRICATION.....	101
8.2.1. Grease lubricated rolling bearings.....	101
8.2.1.1. Motor without grease fitting.....	104
8.2.1.2. Motor with grease fitting.....	104
8.2.1.3. Compatibility of the Mobil Polyrex EM grease with other greases	105
8.2.2. Oil lubricated bearings.....	105
8.2.3. Oil mist lubricated bearings	105
8.2.4. Sleeve bearings.....	106
8.3. MOTOR ASSEMBLY AND DISASSEMBLY.....	106
8.3.1. Terminal box.....	107
8.4. DRYING THE STATOR WINDING INSULATION.....	108
8.5. SPARE PARTS.....	108
9. ENVIRONMENTAL INFORMATION	109
10. TROUBLESHOOTING CHART X SOLUTIONS	109

1. TERMINOLOGY

Balancing: the procedure by which the mass distribution of a rotor is checked and, if necessary, adjusted to ensure that the residual unbalance or the vibration of the journals and/or forces on the bearings at a frequency corresponding to service speed are within specified limits in International Standards.

[ISO 1925:2001, definition 4.1]

Balance quality grade: indicates the peak velocity amplitude of vibration, given in mm/s, of a rotor running free-in-space and it is the product of a specific unbalance and the angular velocity of the rotor at maximum operating speed.

Hazardous area: area in which an explosive atmosphere is present, or may be expected to be present, in quantities such as to require special precautions for the construction, installation, and use of electrical apparatus.

[IEC 60050 IEV number 426-03-01]

Non-hazardous area: area in which an explosive atmosphere is not expected to be present in quantities such as to require special precautions for the construction, installation, and use of electrical apparatus.

[IEC 60050 IEV number 426-03-02]

Explosive atmosphere: a mixture with air, under atmospheric conditions, of flammable substances in the form of gas, vapor, dust, fibers, or flyings which, after ignition, permits self-sustaining propagation.

[IEC 60050 IEV number 426-01-06]

Temperature class: maximum surface temperature of the equipment. Following temperature classes are defined:

Table 1 - Temperature classes

Temperature Class		Maximum surface temperature (°C)
IEC	NEC	
T1	T1	450
T2	T2	300
-	T2A	280
-	T2B	260
-	T2C	230
-	T2D	215
T3	T3	200
-	T3A	180
-	T3B	165
-	T3C	160
T4	T4	135
-	T4A	120
-	T5	100
-	T6	85

[IEC 60050 IEV number 426-01-05]

Simple apparatus: electrical component or combination of components of simple construction with well-defined electrical parameters which is compatible with the intrinsic safety of the circuit in which it is used. For instance: temperature sensors.

[IEC 60050 IEV number 426-11-09]

Flameproof enclosure “db” (Ex db): type of protection in which the parts capable of igniting an explosive gas atmosphere are provided with an enclosure which can withstand the pressure developed during an internal explosion of an explosive mixture, and which prevents the transmission of the explosion to the explosive gas atmosphere surrounding the enclosure.

[IEC 60050 IEV number 426-06-01]

Increased safety - level of protection “eb” (Ex eb): type of protection applied to electrical apparatus in which additional measures are applied so as to give increased security against the possibility of excessive temperatures and of the occurrence of arcs and sparks in normal service or under specified abnormal conditions.

[IEC 60050 IEC number 426-08-01]

Increased safety - level of protection “ec” (Ex ec): type of protection applied to electrical apparatus such that, in normal operation and in certain specified abnormal conditions, it is not capable of igniting a surrounding explosive gas atmosphere.

[IEC 60050 IEC number 426-13-01]

Dust ignition protection by enclosure “t” (Ex t): type of protection for explosive dust atmosphere where electrical equipment is provided with an enclosure providing dust ingress protection and a means to limit surface temperatures.

[IEC 60079-31 item 3.1]

Gas groups: are subdivided according to the nature of the explosive atmosphere for which they are intended:

- Group I: coal mines susceptible to firedamp (methane).
- Group II: areas not susceptible to firedamp. This group is subdivided into:
 - Group IIA (IEC) / D (NEC): propane, acetone, butane, combustible gas, gasoline, ethyl alcohol, methyl alcohol, benzene, etc.
 - Group IIB (IEC) / C (NEC): ethylene, cyclopropane, butadiene 1-3, etc.
 - Group IIC (IEC): hydrogen, acetylene, etc.
 - Group B (NEC): hydrogen.
 - Group A (NEC): acetylene.

Dust groups: are subdivided into (except mines susceptible to firedamp (methane)):

- Group IIIA (IEC): combustible fibers / combustible flyings – solid particles, including fibers larger than 500 µm
- Group IIIB (IEC): electrically nonconductive dusts – solid particles smaller than 500 µm, with electrical resistivity $\leq 10^3 \Omega.m$
- Group IIIC (IEC): electrically conductive dusts - solid particles smaller than 500 µm, with electrical resistivity $> 10^3 \Omega.m$
- Group E (NEC): combustible metallic powders, for example: aluminum, magnesium and their commercial alloys.
- Group F (NEC): combustible carbonaceous dusts that have more than 8% total entrapped volatiles.
- Group G (NEC): atmospheres containing dusts not included in Group E and F, including flour, grain wood, plastic, chemicals, etc.

Flameproof joint: place where the corresponding surfaces of two parts of an enclosure, or the conjunction of enclosures, come together, and which prevents the transmission of an internal explosion to the explosive gas atmosphere surrounding the enclosure.

[IEC 60050 IEC number 426-06-02]

Symbol “X”: symbol used to denote special conditions for safe use.

[IEC 60050 IEC number 426-04-32]


Equipment Protection Level - EPL: level of protection assigned to equipment based on its likelihood of becoming a source of ignition and distinguishing the differences between explosive gas atmospheres, explosive dust atmospheres, and the explosive atmospheres in mines susceptible to firedamp. These EPLs are classified into:

- EPL Ga: equipment for explosive gas atmospheres, having a “very high” level of protection, which is not a source of ignition in normal operation, during expected malfunctions or during rare malfunctions.
- EPL Gb: equipment for explosive gas atmospheres, having a “high” level of protection, which is not a source of ignition in normal operation, during expected malfunctions.

- EPL Gc: equipment for explosive gas atmosphere, having an “enhanced” level of protection, which is not a source of ignition in normal operation and which may have some additional protection to ensure that it remains inactive as an ignition source in case of regular expected occurrences (for example failure of a lamp).
- EPL Da: equipment for explosive dust atmospheres, having a “very high” level of protection, which is not a source of ignition in normal operation, during expected malfunctions, or during rare malfunctions.
- EPL Db: equipment for explosive dust atmospheres, having a “high” level of protection, which is not a source of ignition in normal operation or during expected malfunctions
- EPL Dc: equipment for explosive dust atmospheres, having an “enhanced” level of protection, which is not a source of ignition in normal operation and which may have some additional protection to ensure that it remains inactive as an ignition source in the case of regular expected occurrences (for example failure of a lamp).
- EPL Ma: equipment for installation in a mine susceptible to firedamp, having a “very high” level of protection, which has sufficient security that it is unlikely to become an ignition source in normal operation, during expected malfunctions or during rare malfunctions, even when left energized in the presence of an outbreak of gas.
- EPL Mb: equipment for installation in a mine susceptible to firedamp, having a “high” level of protection, which has sufficient security that it is unlikely to become a source of ignition in normal operation or during expected malfunctions in the time span between there being an outbreak of gas and the equipment being de-energized.

[IEC 60079-0 item 3.18]

Time “ t_E ”: time taken for an a.c. rotor or stator winding, when carrying the initial starting current I_A , to be heated up to the limiting temperature from the temperature reached in rated service at the maximum ambient temperature. See Figure 1-1.

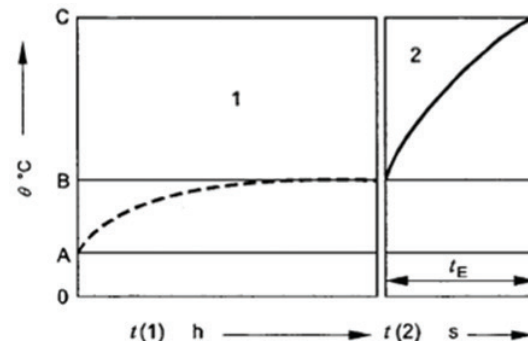

Symbols

- θ - temperature
- A - maximum allowed ambient temperature
- B - service temperature
- C - limiting temperature
- t - time
- 1 - temperature rise in rated service
- 2 - Temperature rise during locked rotor test

Figure 1 - Time “ t_E ”

[IEC 60050 IEV number 426-08-03]

Type of protection: the set of specific measures applied to electrical apparatus to avoid ignition of a surrounding explosive atmosphere by such apparatus.

[IEC 60050 IEV number 426-01-02]

Zones: hazardous areas are classified in terms of zones on the basis of the frequency and duration of the occurrence of an explosive atmosphere.

Zone 0 (IEC) / Class I Div 1 (NEC): the area in which an explosive gas atmosphere is present continuously, or for long periods or frequently.

[IEC 60050 IEV number 426-03-03]

Zone 1 (IEC) / Class I Div 1 (NEC): the area in which an explosive gas atmosphere is likely to occur in normal operation occasionally.

[IEC 60050 IEV number 426-03-04]

Zone 2 (IEC) / Class I, Div 2 (NEC): the area in which an explosive gas atmosphere is not likely to occur in normal operation, but if it does occur, will persist for a short period only.

[IEC 60050 IEV number 426-03-05]

Zone 20 (IEC) / Class II, Div 1 (NEC): the area in which an explosive atmosphere in the form of a cloud of combustible dust in the air is continuously present, or for long periods or frequently.

[IEC 60050 IEV number 426-03-23]

Zone 21 (IEC) / Class II, Div 1 (NEC): the area in which an explosive atmosphere in the form of a cloud of combustible dust in the air is likely to occur, occasionally, in normal operation.

[IEC 60050 IEV number 426-03-24]

Zone 22 (IEC) / Class II, Div 2 (NEC): the area in which an explosive atmosphere in the form of a cloud of combustible dust in the air is not likely to occur in normal operation but, if it does occur, will persist for a short period only.

[IEC 60050 IEV number 426-03-25]

Grounded Part: metallic part connected to the grounding system.

Live Part: Conductor or conductive part intended to be energized in normal operation, including a neutral conductor.

Authorized personnel: the employee who has formal approval of the company.

Qualified personnel: the employee who meets the following conditions simultaneously:

- receives training under the guidance and responsibility of a qualified and authorized professional;
- works under the responsibility of a qualified and approved professional.

Note: *The qualification is only valid for the company that trained the employee in the conditions set out by the authorized and qualified professional responsible for training.*

2. INITIAL RECOMMENDATIONS



Motors for hazardous areas are specially designed to meet the government regulations regarding the environment in which they are installed. Misapplication, incorrect connection or other changes although small, may jeopardize product reliability.

Electric motors have energized circuits, exposed rotating parts and hot surfaces that may cause serious injury to people during normal operation. Therefore, it is recommended that transportation, storage, installation, operation and maintenance services are always performed by qualified personnel.

Also, the applicable procedures and relevant standards of the country where the machine will be installed must be considered.

Noncompliance with the recommended procedures in this manual may cause severe personal injuries and/or substantial property damage and may void the product warranty.

For practical reasons, it is not possible to include in this Manual detailed information that covers all construction variables nor covering all possible assembly, operation or maintenance alternatives.

This Manual contains only the required information that allows qualified and trained personnel to carry out their services. The product images are shown for illustrative purpose only and the type of protection is not represented.

The type of protection and the Equipment Protection Level (EPL) indicated on the motor nameplate must be respected considering the explosive atmosphere where the motor will be installed.

Components added to the motor by the user, such as cable-glands, threaded plugs, encoder, etc. must meet the type of protection, the Equipment Protection Level (EPL) in accordance with the standards indicated on the product certificate.

The symbol “X” added to the certificate number, informed on the motor nameplate, denotes that motor requires special conditions for installation, use and/or maintenance, as described in the certificate.

Failure to follow these requirements may affect the product and installation safety.

For Smoke Extraction Motors, please refer to the additional instruction manual 50026367 available on the website www.weg.net.

For brake motors, please refer to the information contained in WEG 50021973 brake motor manual available on the website www.weg.net.

For Electronically Commutated Motors, please refer to the information contained in WEG 50078700 manual available on the website www.weg.net.

For Roller Table Motors, please refer to the information contained in WEG 14629920 manual available on the website www.weg.net.

For WEG Lift Gearless motors, please refer to the information contained in WEG 50106963 manual available on the website www.weg.net.

For motors supplied with WEG Motor Scan sensor, see installation guidelines Overview of Receipt to Operation Manual (10008475131) available on www.weg.net.

For information about permissible radial and axial shaft loads, please check the product technical catalog.



The user is responsible for the correct classification of the area for the motor installation, for the definition of environment conditions and application characteristics.



During the warranty period, all repair, overhaul and reclamation services must be carried out by WEG authorized Service Centers for explosive atmospheres to maintain the validity of the warranty.

2.1 WARNING SYMBOL



Warning about safety and warranty.

2.2 RECEIVING INSPECTION

All motors are tested during the manufacturing process.

The motor must be checked when received for any damage that may have occurred during the transportation.

All damages must be reported in writing to the transportation company, to the insurance company, and to WEG.

Failure to comply with such procedures will void the product warranty.

You must inspect the product:

- Check if nameplate data complies with the purchase order.
- Special attention should be given to the type of protection and/or to the Equipment Protection Level.
- Remove the shaft locking device (if any) and rotate the shaft by hand to ensure that it rotates freely. Remove the shaft locking device (if any) and rotate the shaft by hand to ensure that it rotates freely. The shaft might not rotate freely in Magnet and WQuattro motors, due to alignment torque from the magnets. It might be necessary to use a lever;



When rotating the shaft, it is necessary to certify that the terminals are insulated to eliminate the risk of electric shock from induced voltage.

- Check that the motor has not been exposed to excessive dust and moisture during transportation.

Do not remove the protective grease from the shaft, or the plugs from the cable entries. These protections must remain in place until the installation has been completed.

2.3 NAMEPLATES

The nameplate contains information that describes the construction characteristics and the performance of the motor. Figure 2, Figure 3 and Figure 4 show nameplate layout examples.

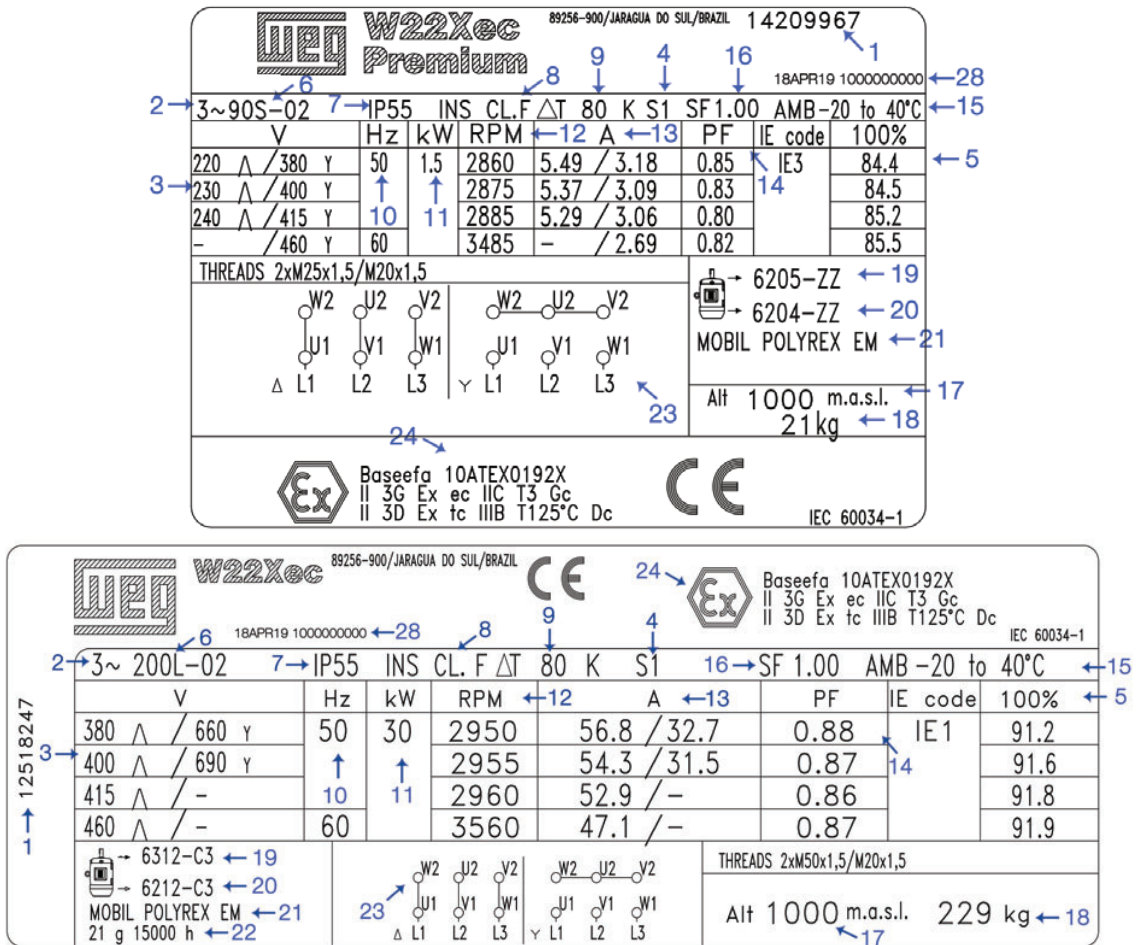


Figure 2 - IEC motors nameplate.

ENGLISH

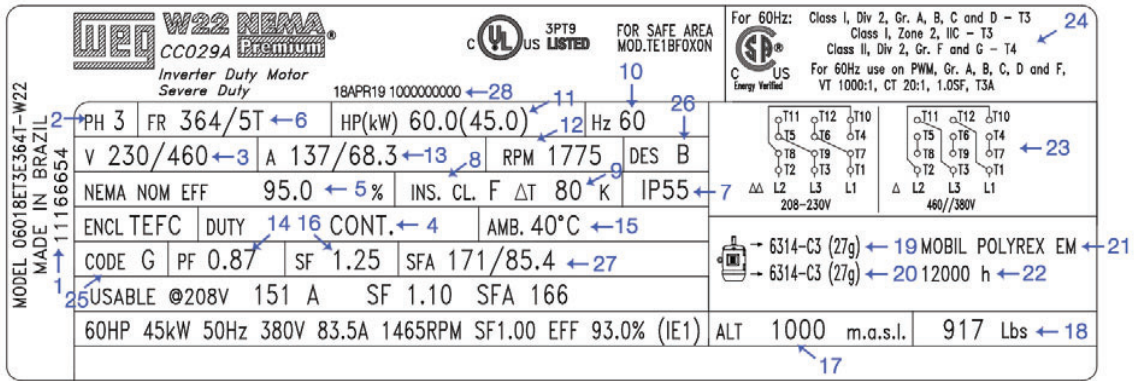
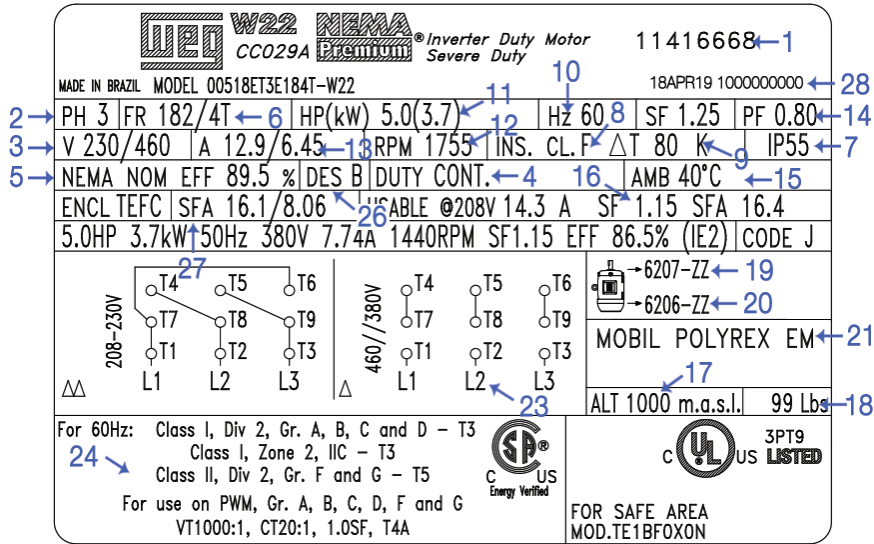


Figure 3 - NEMA motors nameplate.

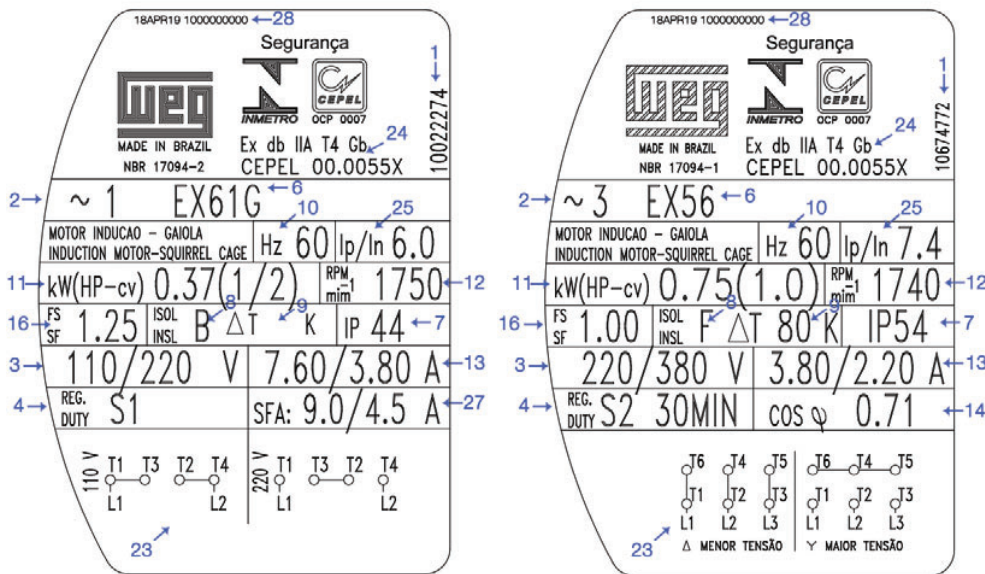


Figure 4 - Nameplate of the fuel pump motors.

Table 2 - Nameplate information

Number	Symbol	Features
1		Motor code (SAP material)
2	~	Number of phases
3	V	Rated voltage (V)
4	REG. / DUTY	Duty
5	REND. / NOM. EFF. / EFF.	Efficiency (%)
6	CARC. / FRAME	Frame
7	IP	Degree of protection
8	ISOL. / INSL. / INS.CL.	Insulation class
9	ΔT	Temperature rise (K)
10	Hz	Frequency (Hz)
11	kW (HP-cv) / kW / HP	Output (kW / HP / cv)
12	RPM / min ⁻¹	Revolution per minute (RPM)
13	A	Rated current (A)
14	F.P / P.F	Power factor
15	AMB.	Ambient Temperature (°C)
16	F.S. / S.F.	Service factor
17	ALT.	Altitude (m.a.s.l.)
18	kg / lb / WEIGHT	Weight (kg / lb)
19		DE bearing specification and amount of grease
20		NDE bearing specification and amount of grease
21		Grease type used for bearing lubrication
22		Lubrication interval (h)
23		Connection diagram
24		Hazardous areas / Type of protection / Certificate ¹⁾
25	$I_A / I_N / I_P / I_N$	Starting current / rated current relationship
26	CAT. / DES.	Design
27	I.F.S. / S.F.A.	Service factor amps (A)
28		Serial number

1)The product certificates can be obtained from WEG. Please contact WEG nearest Office.

Motor marking intended for use in hazardous areas: the marking system is indicated according to the standards applicable for each type of protection:

Table 3 - Marking according to IEC

Marking according to IEC				
Ex equipment	Type of protection	Apparatus grouping for gas or dust	Temperature Class	Equipment Protection Level EPL
Ex	ec	IIC	T3	Gc
	eb	IIC	T3	Gb
	db	IIB	T4	
		IIC		
	db eb	IIB		
		IIC		
	tc	IIIB	T125 °C	Dc
	tb	IIIC		Db
db	I	-	Mb	

Table 4 - Marking according to NEC

Marking according to NEC			
Class	Division or Zone	Apparatus grouping for gas or dust	Temperature class
Class I	Division 1	Gr. C and D	T4
Class II	Division 1	Gr. E, F and G	T4
Class I	Zone 1	IIB	T4
Class II	Zone 21	IIIC	T125 °C
Class II	Zone 22	IIIB	T125 °C
Class I	Division 2	Gr. A, B, C and D	T3

* Other temperature classes are available upon request.

Table 5 - Marking according to ATEX

Marking according to ATEX							
Apparatus grouping	Equipment category	Gas, dust or mine	Ex equipment	Type of protection	Apparatus grouping for gas or dust	Temperature class	Equipment Protection Level (EPL)
II	3	G	Ex	ec	IIC	T3	Gc
	2			eb	IIC	T3	Gb
				db	IIB	T4	
					IIC		
	db eb	IIB					
	IIC						
3	D	tc	IIIB	T125 °C	Dc		
2		tb	IIIC		Db		
I	-	M2	db	I	-	Mb	

* Other temperature classes are available upon request.

3. SAFETY INSTRUCTIONS



The motor must be disconnected from the power supply and be completely stopped before conducting any installation or maintenance procedures. Additional measures should be taken to avoid accidental motor starting.



Professionals working with electrical installations, either in the assembly, operation or maintenance, should use proper tools and be instructed on the application of standards and safety requirements, including the use of Personal Protective Equipment (PPE) that must be carefully observed in order to reduce risk of personal injury during these services.



Electric motors have energized circuits, exposed rotating parts and hot surfaces that may cause serious injury to people during normal operation. It is recommended that transportation, storage, installation, operation and maintenance services are always performed by qualified personnel.



Pacemaker users and unqualified personnel shall not open Magnet and WQuattro motors, because high energy magnets are used.

Always follow the safety, installation, maintenance and inspection instructions in accordance with the applicable standards in each country.

4. HANDLING AND TRANSPORT

Individually packaged motors should never be lifted by the shaft or by the packaging. They must be lifted only by means of the eyebolts when supplied. Use always suitable lifting devices to lift the motor. Eyebolts on the frame are designed for lifting the machine weight only as indicated on the motor nameplate. Motors supplied on pallets must be lifted by the pallet base with lifting devices fully supporting the motor weight. The package should never be dropped. Handle it carefully to avoid bearing damage.



Eyebolts provided on the frame are designed for lifting the machine only. Do not use these eyebolts for lifting the motor with coupled equipment such as bases, pulleys, pumps, reducers, etc.

Never use damaged, bent or cracked eyebolts. Always check the eyebolt condition before lifting the motor.

Eyebolts mounted on components, such as on end shields, forced ventilation kits, etc. must be used for lifting these components only. Do not use them for lifting the complete machine set.

Handle the motor carefully without sudden impacts to avoid bearing damage and prevent excessive mechanical stresses on the eyebolts resulting in its rupture.



To move or transport motors with cylindrical roller bearings or angular contact ball bearings, use always the shaft locking device provided with the motor.

All HGF, W50, W60 and W51 HD motors, regardless of bearing type, must be transported with shaft locking device fitted.

4.1 LIFTING



Before lifting the motor ensure that all eyebolts are tightened properly and the eyebolt shoulders are in contact with the base to be lifted, as shown in Figure 5. Figure 6 shows an incorrect tightening of the eyebolt.

Ensure that lifting machine has the required lifting capacity for the weight indicated on the motor nameplate.




Figure 5 - Correct tightening of the eyebolt




Figure 6 - Incorrect tightening of the eyebolt.



The center-of-gravity may change depending on motor design and accessories. During the lifting procedures, the maximum angle allowed of inclination should never be exceeded as specified below.

4.1.1 Horizontal motors with one eyebolt

For horizontal motors fitted with only one eyebolt, the maximum allowed angle-of-inclination during the lifting process should not exceed 30° in relation to the vertical axis, as shown in Figure 7.

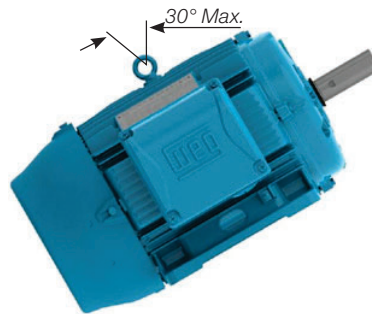


Figure 7 - Maximum allowed angle-of-inclination for the motors with one eyebolt.

4.1.2 Horizontal motor with two eyebolts

When motors are fitted with two or more eyebolts, all supplied eyebolts must be used simultaneously for the lifting procedure.

There are two possible eyebolt arrangements (vertical and inclined), as shown below:

- For motors with vertical lifting eyebolts, as shown in Figure 8, the maximum allowed lifting angle should not exceed 45° in relation to the vertical axis. We recommend using a spreader beam for maintaining the lifting elements (chain or rope) in the vertical position and thus preventing damage to the motor surface.




Figure 8 - Maximum resultant angle for motors with two or more lifting eyebolts.

- For HGF motors, as shown in Figure 9, the maximum resulting angle should not exceed 30° in relation to the vertical axis.

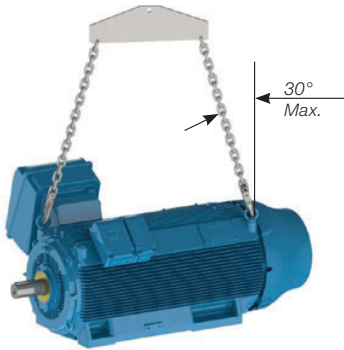


Figure 9 - Maximum resultant angle for horizontal HGF motors

For W60 motors, as shown in Figure 10, the use of a spreader beam is required for maintaining the lifting elements (chain or rope) in vertical position and thus preventing damage to the motor surface.

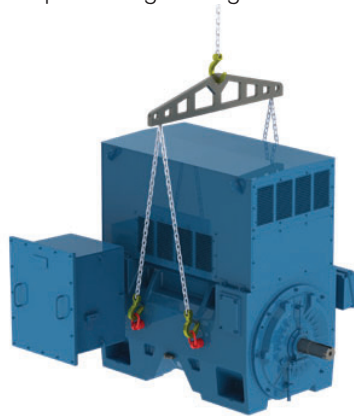


Figure 10 - Lifting for W60 motors with paralel chains

- For motors fitted with inclined eyebolts, as shown in Figure 11, the use of a spreader beam is required for maintaining the lifting elements (chain or rope) in the vertical position and thus preventing damage to the motor surface.



Figure 11 - Use of a spreader beam for lifting.

ENGLISH

4.1.3 Vertical Motors

For vertically mounted motors, as shown in Figure 12 the use of a spreader beam is required for maintaining the lifting element (chain or rope) in the vertical position and thus preventing damage to the motor surface.



Figure 12 - Lifting of vertically mounted motors.



Always use the eyebolts mounted on the top side of the motor, diametrically opposite, considering the mounting position. See Figure 13.



Figure 13 - Lifting of HGF motors.

4.1.3.1 Procedures to place W22 motors in the vertical position

For safety reasons during the transport, vertical mounted Motors are usually packed and supplied in the horizontal position.

To place W22 motors fitted with eyebolts (see Figure 11), to the vertical position, proceed as follows:

1. Ensure that the eyebolts are tightened properly, as shown in Figure 5;
2. Remove the motor from the packaging, using the top mounted eyebolts, as shown in Figure 14;



Figure 14 - Removing the motor from the packaging.



Figure 15 - Installation of the second pair of eyebolts.

4. Reduce the load on the first pair of eyebolts to start the motor rotation, as shown in Figure 16. This procedure must be carried out slowly and carefully.



Figure 16 - End result: motor placed in the vertical position.

These procedures will help you to move motors designed for vertical mounting. These procedures are also used to place the motor from the horizontal position into the vertical position and vertical to horizontal.

4.1.3.2 Procedures to place HGF, W50 and W51 HD motors in the vertical position

HGF motors are fitted with eight lifting points: four at drive end and four at non-drive end. W50 and W51 HD motors are fitted with nine lifting points: four at drive end, one in the central part and four at non-drive end. The motors are usually transported in horizontal position, however for the installation they must be placed in the vertical position. To place an these motors in the vertical position, proceed as follows:

1. Lift the motor by using the four lateral eyebolts and two hoists, see Figure 17;

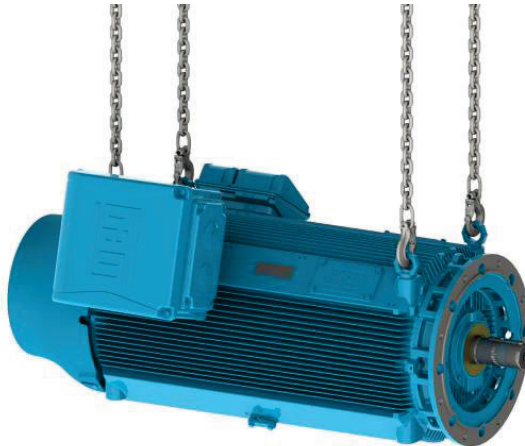


Figure 17 - Lifting of HGF, W50 and W51 HD motors with two hoists

2. Lower the hoist fixed to motor drive end while lifting the hoist fixed to motor non-drive end until the motor reaches its equilibrium, see Figure 18;



Figure 18 - Placing HGF, W50 and W51 HD motors in vertical position

3. Remove the hoist hooks from the drive end eyebolts and rotate the motor 180° to fix the removed hooks into the two eyebolts at the motor non-drive end, see Figure 19;



Figure 19 - Lifting HGF, W50 and W51 HD motors by the eyebolts at the non-drive end

4. Fix the removed hoist hooks in the other two eyebolts at the non-drive end and lift the motor until the vertical position is reached, see Figure 20.



Figure 20 - HGF, W50 and W51 HD motors in the vertical position

These procedures will help you to move motors designed for vertical mounting. These procedures are also used to place the motor from the horizontal position into the vertical position and vertical to horizontal.

4.2 PROCEDURES TO PLACE W22 VERTICAL MOUNT MOTORS IN THE HORIZONTAL POSITION

To place W22 vertical mount motor in the horizontal position, proceed as follows:

1. Ensure that all eyebolts are tightened properly, as shown in Figure 5;

2. Install the first pair of eyebolts and lift the motor as shown in Figure 21;



Figure 21 - Install the first pair of eyebolts

3. Install the second pair of eyebolts, as shown in Figure 22;



Figure 22 - Install the second pair of eyebolts

4. Reduce the load on the first pair of eyebolts for rotating the motor, as shown in Figure 23. This procedure must be carried out slowly and carefully.



Figure 23 - Motor is being rotated to the horizontal position

5. Remove the first pair of eyebolts, as shown in Figure 24.



Figure 24 - Final result: motor placed in the horizontal position

ENGLISH

5. STORAGE

If the motor is not installed immediately, it must be stored in a dry and clean environment, with relative humidity not exceeding 60%, with an ambient temperature between 5 °C and 40 °C, without sudden temperature changes, free of dust, vibrations, gases or corrosive agents. The motor must be stored in the horizontal position, unless specifically designed for vertical operation, without placing objects on it. Do not remove the protective grease from shaft end to prevent rust.

If the motor is fitted with space heaters, they must always be turned on during the storage period or when the installed motor is out of operation. Space heaters will prevent water condensation inside the motor and keep the winding insulation resistance within acceptable levels. Store the motor in such position that the condensed water can be easily drained. If fitted, remove pulleys or couplings from the shaft end (more information are given on item 6).



The space heaters should never be energized when the motor is in operation.

For the use of space heaters in motors that are stored in a hazardous area, adopt the same cable inlet and connection requirements described in item 6.

5.1 EXPOSED MACHINED SURFACES

All exposed machined surfaces (like shaft end and flange) are factory-protected with a temporary rust inhibitor. A protective film must be reapplied periodically (at least every six months), or when it has been removed and/or damaged.

5.2 STORAGE

The stacking height of the motor packaging during the storage period should not exceed 5 m, always considering the criteria indicated in Table 6:

Table 6 - Maximum recommended stacking height

Packaging Type	Frame sizes	Maximum stacking quantity
Cardboard box	IEC 63 to 132 NEMA 143 to 215	Indicated on the top side of the cardboard box
Wood crate	IEC 63 to 315 NEMA 48 to 504/5	06
	IEC 355 NEMA 586/7 and 588/9	03
	W40 / W50 / W60 / W51 HD / HGF IEC 315 to 630 HGF NEMA 5000 to 9600	Indicated on the packaging

Notes:

- 1) Never stack larger packaging onto smaller packaging.
- 2) Align the packaging correctly (see Figure 25 and Figure 26).

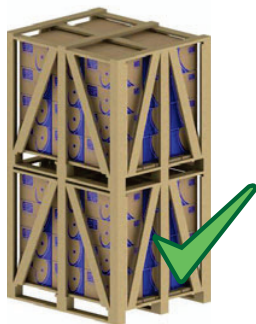


Figure 25 - Correct stacking



Figure 26 - Incorrect stacking

- 3) The feet of the crates above should always be supported by suitable wood battens (Figure 27) and never stand on the steel tape or without support (Figure 28).



Figure 27 - Correct stacking



Figure 28 - Incorrect stacking

4) When stacking smaller crates onto longer crates, always ensure that suitable wooden supports are provided to withstand the weight (see Figure 29). This condition usually occurs with motor packaging above IEC 225S/M (NEMA 364/5T) frame sizes.



Figure 29 - Use of additional battens for stacking

5.3 BEARINGS

5.3.1 Grease lubricated bearings

We recommend rotating the motor shaft at least once a month (by hand, at least five revolutions, stopping the shaft at a different position from the original one). The shaft might not rotate freely in Magnet and WQuattro motors, due to alignment torque from the magnets. It might be necessary to use a lever.



When rotating the shaft, it is necessary to certify that the terminals are insulated to eliminate the risk of electric shock from induced voltage.

If the motor is fitted with a shaft locking device, remove it before rotating the shaft and install it again before performing any handling procedure. Vertical motors may be stored in the vertical or in the horizontal position. If motors with open bearings are stored longer than six months, the bearings must be relubricated according to Item 8.2 before commissioning of the motor.

If the motor is stored for longer than 2 years, the bearings must be replaced or removed, washed, inspected and relubricated according to Item 8.2.

5.3.2 Oil Lubricated bearings

The motor must be stored in its original operating position and with oil in the bearings. Correct oil level must be ensured. It should be in the center of the sight glass.

During the storage period, remove the shaft locking device and rotate the shaft by hand every month, at least five revolutions, thus achieving an even oil distribution inside the bearing and maintaining the bearing in good operating conditions. Reinstall the shaft locking device every time the motor has to be moved.

If the motor is stored for a period of over six months, the bearings must be relubricated according to Item 8.2 before starting the operation. If the motor is stored for a period of over two years, the bearings must be replaced or removed, washed according to manufacturer instructions, checked and relubricated according to Item 8.2.

The oil of vertically mounted motors that are transported in the horizontal position is removed to prevent oils leaks during the transport. These motors must be stored in the vertical position after receiving and the bearing must be lubricated.

5.3.3 Oil Mist lubricated bearings

The motor must be stored in the horizontal position. Lubricate the bearings with ISO VG 68 mineral oil in the amount indicated in Table 7 (this is also valid for bearings with equivalent dimensions). After filling with oil, rotate the shaft by hand, at least five revolutions)

During the storage period, remove the shaft locking device (if any) and rotate the shaft by hand every week, at least five revolutions, stopping it at a different position from the original one. Reinstall the shaft locking device every time the motor has to be moved. If the motor is stored for a period of over two years, the bearings must be replaced or removed, washed according to manufacturer instructions, checked and relubricated according to item 8.2.

Table 7 - Amount of oil per bearing

Bearing Size	Amount of Oil (ml)	Bearing Size	Amount of Oil (ml)
6201	15	6309	65
6202	15	6311	90
6203	15	6312	105
6204	25	6314	150
6205	25	6315	200
6206	35	6316	250
6207	35	6317	300
6208	40	6319	350
6209	40	6320	400
6211	45	6322	550
6212	50	6324	600
6307	45	6326	650
6308	55	6328	700

The oil must always be removed when the motor has to be handled. If the oil mist system is not operating after installation, fill the bearings with oil to prevent bearing rusting. During the storage period, rotate the shaft by hand, at least five revolutions, stopping it at a different position from the original one. Before starting the motor, all bearing protection oil must be drained from the bearing and the oil mist system must be switched ON.

5.3.4 Sleeve Bearing

The motor must be stored in its original operating position and with oil in the bearings. Correct oil level must be ensured. It should be in the middle of the sight glass. During the storage period, remove the shaft locking device and rotate the shaft by hand every month, at least five revolutions (and at 30 rpm), thus achieving an even oil distribution inside the bearing and maintaining the bearing in good operating conditions. Reinstall the shaft locking device every time the motor has to be moved.

If the motor is stored for a period of over six months, the bearings must be relubricated according to Item 8.2 before starting the operation.

If the motor is stored for a period longer than the oil change interval, or if it is not possible to rotate the motor shaft by hand, the oil must be drained and corrosion protection and dehumidifiers must be applied.

5.4 INSULATION RESISTANCE

We recommend measuring the winding insulation resistance at regular intervals to follow-up and evaluate its electrical operating conditions. If any reduction in the insulation resistance values is recorded, the storage conditions should be evaluated and corrected, where necessary.

5.4.1 Insulation resistance measurement

We recommend measuring the winding insulation resistance at regular intervals to follow-up and evaluate its electrical operating conditions. If any reduction in the insulation resistance values is recorded, the storage conditions should be evaluated and corrected, where necessary.



The insulation resistance must be measured in a safe environment.

The insulation resistance must be measured with a megohmmeter. The machine must be in a cold state and disconnected from the power supply.



To prevent the risk of an electrical shock, ground the terminals before and after each measurement. Ground the capacitor (if any) to ensure that it is fully discharged before the measurement is taken.

It is recommended to insulate and test each phase separately. This procedure allows the comparison of the insulation resistance between each phase. During the test of one phase, the other phases must be grounded. The test of all phases simultaneously evaluates the insulation resistance to ground only but does not evaluate the insulation resistance between the phases.

The power supply cables, switches, capacitors and other external devices connected to the motor may considerably influence the insulation resistance measurement. Thus all external devices must be disconnected and grounded during the insulation resistance measurement.

Measure the insulation resistance one minute after the voltage has been applied to the winding. The applied voltage should be as shown in Table 8.

Table 8 - Voltage for the insulation resistance

Winding rated voltage (V)	Testing voltage for measuring the insulation resistance (V)
< 1000V	500
1000 - 2500	500 - 1000
2501 - 5000	1000 - 2500
5001 - 12000	2500 - 5000
> 12000	5000 - 10000

The reading of the insulation resistance must be corrected to 40 °C as shown in Table 9.

Table 9 - Correction Factor for the Insulation Resistance corrected to 40 °C

Measuring temperature of the insulation resistance (°C)	Correction factor of the insulation resistance corrected to 40 °C	Measuring temperature of the insulation resistance (°C)	Correction factor of the insulation resistance corrected to 40 °C
10	0.125	30	0.500
11	0.134	31	0.536
12	0.144	32	0.574
13	0.154	33	0.616
14	0.165	34	0.660
15	0.177	35	0.707
16	0.189	36	0.758
17	0.203	37	0.812
18	0.218	38	0.871
19	0.233	39	0.933
20	0.250	40	1.000
21	0.268	41	1.072
22	0.287	42	1.149
23	0.308	43	1.231
24	0.330	44	1.320
25	0.354	45	1.414
26	0.379	46	1.516
27	0.406	47	1.625
28	0.435	48	1.741
29	0.467	49	1.866
30	0.500	50	2.000

The motor insulation condition must be evaluated by comparing the measured value with the values indicated in Table 10 (corrected to 40 °C):

Table 10 - Evaluation of the insulation system

Limit value for rated voltage up to 1.1 kV (MΩ)	Limit value for rated voltage above 1.1 kV (MΩ)	Situation
Up to 5	Up to 100	Dangerous. The motor can not be operated in this condition
5 to 100	100 to 500	Regular
100 to 500	Higher than 500	Good
Higher than 500	Higher than 1000	Excellent

The values indicated in the table should be considered only as reference values. It is advisable to log all measured values to provide a quick and easy overview of the machine insulation resistance.

If the insulation resistance is low, moisture may be present in the stator windings. In this case, the motor should be removed and transported to a WEG authorized Service Center for proper evaluation and repair (This service is not covered by the warranty). To improve the insulation resistance through the drying process, see section 8.4.

6. INSTALLATION



The installation of electric motors in hazardous areas must be always performed by qualified personnel with knowledge on relevant standards and safety rules.

Check some aspects before proceeding with the installation:

1. Insulation resistance: must be within the acceptable limits. See item 5.4.
2. Bearings:
 - If the electric motor is installed without running immediately, proceed as described in item 5.3.
3. Operating conditions of the start capacitors: If single-phase motors are stored for a period of over two years, it is recommended to change the start capacitors before motor starting since they lose their operating characteristics.
4. Terminal box:
 - a. the inside of the terminal box must be clean and dry.
 - b. the contacts must be correctly connected and corrosion free. See 6.9 and 6.10.
 - c. the cable entries must be correctly sealed and the terminal box cover properly mounted in order to ensure the degree of protection indicated on the motor nameplate.
5. Cooling: the cooling fins, air inlet, and outlet openings must be clean and unobstructed. The distance between the air inlet openings and the wall should not be shorter than $\frac{1}{4}$ (one quarter) of the diameter of the air inlet. Ensure sufficient space to perform the cleaning services. See item 7.
6. Coupling: remove the shaft locking device (where fitted) and the corrosion protection grease from the shaft end, including the grounding brush area, and flange immediately before installing the motor. See item 6.4.
7. Drain hole: the motor must always be positioned so the drain hole is at the lowest position (If there is any indication arrow on the drain, the drain must be so installed that the arrow points downwards).

Motors supplied with rubber drain, threaded drain or any other open/close drain plugs must be opened periodically to allow the exit of condensed water. For environments with high water condensation levels and motor with the degree of protection IP55, the drain plugs can be mounted in open position (see Figure 30). For motors with the degree of protection IP56, IP65 or IP66, the drain plugs must remain at closed position (see Figure 30), being opened only during the motor maintenance procedures. The drain system of motors with Oil Mist lubrication system must be connected to a specific collection system (see Figure 41).

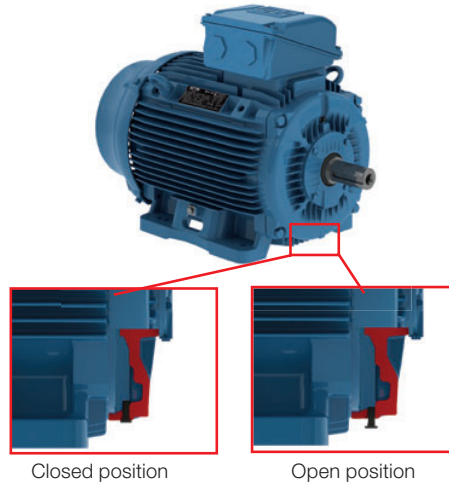


Figure 30 - Detail of the rubber drain plug mounted in a closed and open position.

8. Additional recommendations:

- a. Check the direction of motor rotation, starting the motor at no-load before coupling it to the load.
- b. Vertically mounted motors with shaft end down must be fitted with drip cover to protect them from liquids or solids that may drop onto the motors.
- c. Vertically mounted motors with shaft end up should be fitted with water slinger ring to prevent water ingress inside the motor.
- d. The fixing elements mounted in the threaded through holes in the motor enclosure (for example, the flange must be properly sealed).



Remove or fix the shaft key before starting the motor.

6.1 FOUNDATIONS

The foundation is the structure, structural element, natural or prepared base, designed to withstand the stresses produced by the installed equipment, ensuring safe and stable performance during operation. The foundation design should consider the adjacent structures to avoid the influences of other installed equipment and no vibration is transferred through the structure.

The foundation must be flat and its selection and design must consider the following characteristics:

- a) The features of the machine to be installed on the foundation, the driven loads, application, maximum allowed deformations, and vibration levels (for instance, motors with reduced vibration levels, foot flatness, flange concentricity, axial and radial loads, etc. lower than the values specified for standard motors).
- b) Adjacent buildings, conservation status, maximum applied load estimation, type of foundation and fixation and vibrations transmitted by these constructions.

If the motor is supplied with leveling/alignment bolts, this must be considered in the base design.



Please consider for the foundation dimensioning all stresses that are generated during the operation of the driven load.

The user is responsible for the foundation designing and construction.

The foundation stresses can be calculated by using the following equations (see Figure 31):

$$F_1 = 0,5 * g * m - (4 * T_b / A)$$

$$F_2 = 0,5 * g * m + (4 * T_b / A)$$

Where:

F_1 and F_2 = lateral stresses (N);

g = gravitational acceleration (9,8 m/s²);

m = motor weight (kg);

T_b = breakdown torque (Nm);

A = distance between centerlines of mounting holes in feet or base of the machine (end view) (m).

The motors may be mounted on:

- Concrete bases: are most used for large-size motors (see Figure 31);
- Metallic bases: are generally used for small-size motors (see Figure 32).

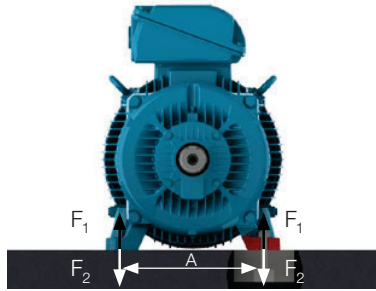


Figure 31 - Motor installed on a concrete base



Figure 32 - Motor installed on a metallic base

The metallic and concrete bases may be fitted with a sliding system. These types of foundations are generally used where the power transmission is achieved by belts and pulleys. This power transmission system is easier to assemble/disassemble and allows the belt tension adjustment. Another important aspect of this foundation type is the location of the base locking screws that must be diagonally opposite. The rail nearest the drive pulley is placed in such a way that the positioning bolt is between the motor and the driven machine. The other rail must be placed with the bolt on the opposite side (diagonally opposite), as shown in Figure 33.

To facilitate assembly, the bases may have the following features:

- shoulders and/or recesses;
- anchor bolts with loose plates;
- bolts cast in the concrete;
- leveling screws;
- positioning screws;
- steel & cast iron blocks, plates with flat surfaces.

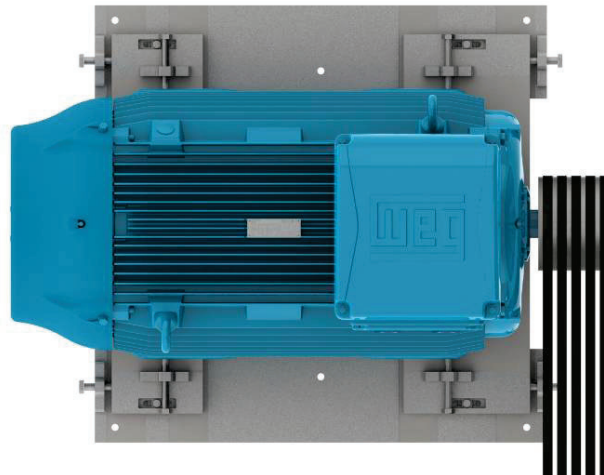


Figure 33 - Motor installed on a sliding base

After completing the installation, it is recommended that all exposed machined surfaces are coated with a suitable rust inhibitor.

6.2 MOTOR MOUNTING



Footless motors supplied with transportation devices, according to Figure 34, must have their devices removed before starting the motor installation.

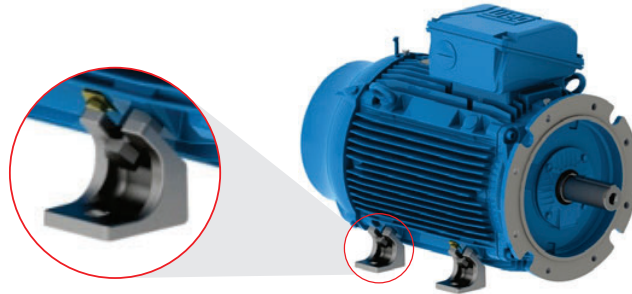


Figure 34 - Detail of transportation devices for footless motors.

6.2.1 Foot mounted motors

The drawings of the mounting hole dimensions for NEMA or IEC motors can be checked in the respective technical catalog.

The motor must be correctly aligned and leveled with the driven machine. Incorrect alignment and leveling may result in bearing damage, generate excessive vibration and even shaft distortion/breakage.

For more details, see section 6.5 and 6.6. The thread engagement length of the mounting bolt should be at least 1.5 times the bolt diameter. This thread engagement length should be evaluated in more severe applications and increased accordingly.

Figure 35 shows the mounting system of a foot mounted motor indicating the minimum required thread engagement length.

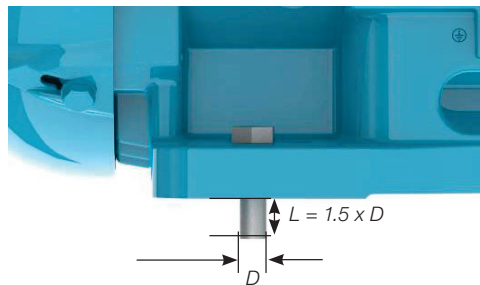


Figure 35 - Mounting system of a foot mounted motor

6.2.2 Flange mounted motors

The drawings of the flange mounting dimensions, IEC and NEMA flanges, can be checked in the technical catalog. The coupling of the driven equipment to the motor flange must be properly dimensioned to ensure the required concentricity of the assembly.

Depending on the flange type, the mounting can be performed from the motor to the driven equipment flange (flange FF (IEC) or D (NEMA)) or from the driven equipment flange to the motor (flange C (DIN or NEMA)).

For the mounting process from the driven equipment flange to the motor, you must consider the bolt length, flange thickness and the thread depth of the motor flange.



If the motor flange has tapped through-holes, the length of the mounting bolts must not exceed the tapped through-hole length of the motor flange, thus preventing damage to the winding head.

For flange mounting the thread engagement length of the mounting bolt should be at least 1.5 times the bolt diameter. In severe applications, longer thread engagement length may be required.

In severe applications or if large motors are flange mounted, a foot or pad mounting may be required in addition to the flange mounting (Figure 36). The motor must never be supported on its cooling fins.

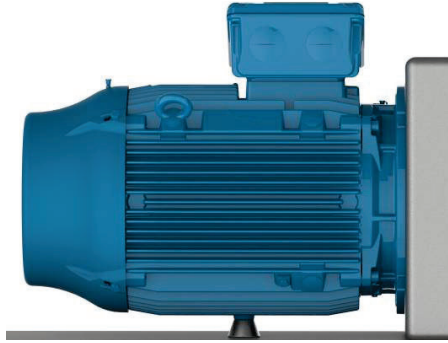


Figure 36 - Mounting method of flange mounted motors with a frame base support

Note:

When the liquid (for example oil) is likely to come into contact with the shaft seal, please contact your local WEG representative.

6.2.3 Pad mounted motors

Typically, this method of mounting is used in axial fans. The motor is fixed by tapped holes in the frame. The dimensions of these tapped holes can be checked in the respective product catalog. The selection of the motor mounting rods/bolts must consider the dimensions of the fan case, the installation base and the thread depth in the motor frame.

The mounting rods and the fan case wall must be sufficiently stiff to prevent the transmission of excessive vibration to the machine set (motor & fan). Figure 37 shows the pad mounting system.

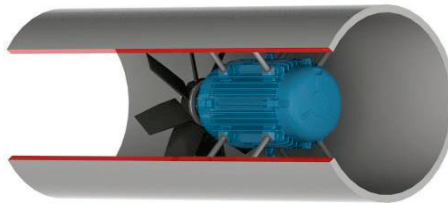


Figure 37 - Mounting of the motor inside the cooling duct

6.3 BALANCING

Unbalanced machines generate vibration which can result in damage to the motor. WEG motors are dynamically balanced with “half key” and without load (uncoupled). Special balancing quality level must be stated in the Purchase Order.



The transmission elements, such as pulleys, couplings, etc., must be balanced with “half key” before they are mounted on the motor shaft.

The balance quality grade meets the applicable standards for each product line.

The maximum balancing deviation must be recorded in the installation report.

6.4 COUPLINGS

Couplings are used to transmit the torque from the motor shaft to the shaft of the driven machine. The following aspects must be considered when couplings are installed:

- Use proper tools for coupling assembly & disassembly to avoid damages to the motor and bearings.
- Whenever possible, use flexible couplings since they can absorb eventual residual misalignments during the machine operation.
- The maximum loads and speed limits informed in the coupling and motor manufacturer catalogs cannot be exceeded.
- Level and align the motor as specified in sections 6.5 and 6.6, respectively.



Remove or fix the shaft key firmly when the motor is operated without coupling in order to prevent accidents.

6.4.1 Direct coupling

Direct coupling is characterized when the Motor shaft is directly coupled to the shaft of the driven machine without transmission elements. Whenever possible, use direct coupling due to lower cost, less space required for installation and more safety against accidents.



Do not use roller bearings for direct coupling unless sufficient radial load is expected.

6.4.2 Gearbox coupling

Gearbox coupling is typically used where speed reduction is required. Make sure that shafts are perfectly aligned and strictly parallel (in case of straight spur gears) and in the right meshing angle (in case of bevel and helical gears).

6.4.3 Pulley and belt coupling

Pulleys and belts are used when speed increase or reduction between motor the shaft and driven load is required.



Excessive belt tension will damage the bearings and cause unexpected accidents such as breakage of the motor shaft.



To prevent the buildup of static electricity in the belt drive system, use only properly grounded belts in conductive construction.

6.4.4 Coupling of sleeve bearing motors



Motors designed with sleeve bearings must be operated with direct coupling to the driven machine or a gearbox. Pulley and belts cannot be applied for a sleeve bearing motors.

Motors designed with sleeve bearings have 3 (three) marks on the shaft end. The center mark is the indication of the magnetic center and the 2 (two) outside marks indicate the allowed limits of the rotor axial movement, as shown in Figure 38.

The motor must be so coupled that during operation the arrow on the frame is placed over the central mark indicating the rotor magnetic center. During start-up, or even during operation, the rotor may freely move between the two outside marks when the driven machine exerts an axial load on the motor shaft. However, under no circumstance, the motor can operate continuously with axial forces on the bearing.

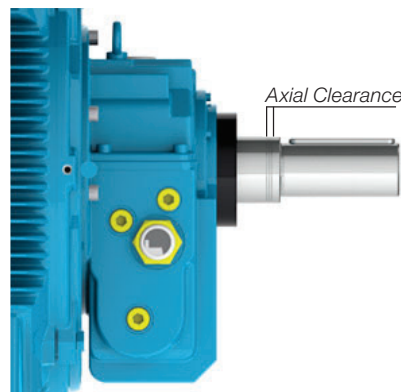


Figure 38 - Axial clearance of motor designed with sleeve bearing



For coupling evaluation, consider the maximum axial bearing clearance as shown in Table 11. The axial clearance of the driven machine and coupling influence the maximum bearing clearance.

Table 11 - Clearance used for sleeve bearings

Bearing size	Total axial clearance (mm)
9*	3 + 3 = 6
11*	4 + 4 = 8
14*	5 + 5 = 10
18	7,5 + 7,5 = 15

* For Motors in accordance with API 541, the total axial clearance is 12.7 mm

The sleeve bearings used by WEG were not designed to support axial load continuously. Under no circumstance must the motor be operated continuously at its axial clearance limits.

6.5 LEVELING

The motor must be leveled to correct any deviations in flatness arising from the manufacturing process and the material structure rearrangement. The leveling can be carried out by a leveling screw fixed on the motor foot or on the flange or by means of thin compensation shims. After the leveling process, the leveling height between the motor mounting base and the motor cannot exceed 0.1 mm.

If a metallic base is used to level the height of the motor shaft end and the shaft end of the driven machine, level only the metallic base relating to the concrete base.

Record the maximum leveling deviations in the installation report.

6.6 ALIGNMENT

The correct alignment between the motor and the driven machine is one of the most important variables that extend the useful service life of the motor. Incorrect coupling alignment generates high loads and vibrations reducing the useful life of the bearings and even resulting in shaft breakages. Figure 39 illustrates the misalignment between the motor and the driven machine.

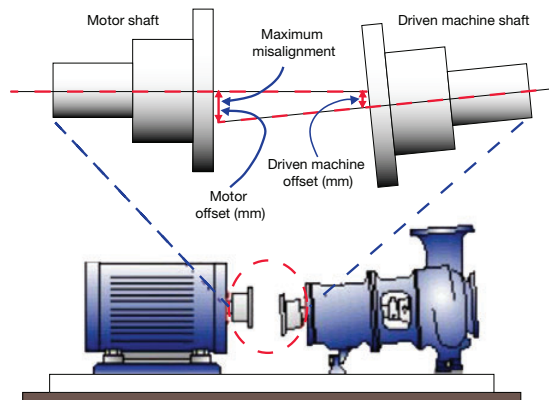


Figure 39 - Typical misalignment condition

Alignment procedures must be carried out using suitable tools and devices, such as dial gauge, laser alignment instruments, etc. The motor shaft must be aligned axially and radially with the driven machine shaft. The maximum allowed eccentricity for a complete shaft turn should not exceed 0.03 mm when alignment is made with dial gauges, as shown in Figure 40. Ensure a gap between couplings to compensate for the thermal expansion between the shafts as specified by the coupling manufacturer.

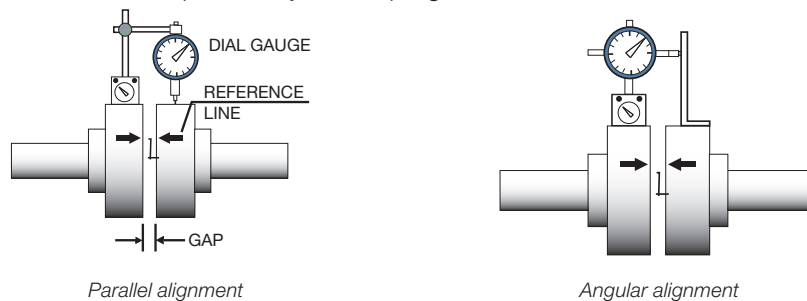


Figure 40 - Alignment with a dial gauge.

If the alignment is made by a laser instrument, please consider the instructions and recommendations provided by the laser instrument manufacturer.

ENGLISH

The thermal expansion between the feet and the shaft center line of the motor can be approximately calculated by $\Delta H = 0.08\% \times H$, where ΔH is the shaft height thermal expansion (in mm) and H is the motor shaft height (in mm). If the axially locked bearing is at the non-drive end of the motor, make sure that a continuous free axial movement is possible between the coupling in order to permit thermal expansion of the motor shaft.

The expected axial thermal expansion of the shaft can be calculated by $\Delta L = 0.36\% \times H$, where ΔL is the axial thermal expansion (in mm) and H is the motor shaft height (in mm).

The alignment should be checked at ambient temperature with a machine at operating temperature.



The coupling alignment must be checked periodically.

Pulley and belt couplings must be so aligned that the driver pulley center lies in the same plane of the driven pulley center and the motor shaft and the shaft of the driven machine are perfectly parallel.

After completing the alignment procedures, ensure that mounting devices do not change the motor and machine alignment and leveling resulting in machine damage during operation.

It is recommended to record the maximum alignment deviation in the Installation Report.

6.7 CONNECTION OF OIL LUBRICATED OR OIL MIST LUBRICATED MOTORS

When oil lubricated or oil mist lubricated motors are installed, connect the existing lubricant tubes (oil inlet and oil outlet tubes and motor drain tube), as shown in Figure 41. The lubrication system must ensure continuous oil flow through the bearings as specified by the manufacturer of the installed lubrication system.

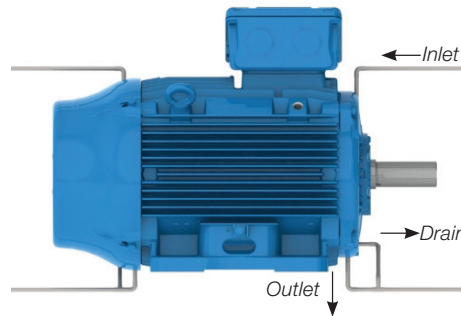


Figure 41 - Oil supply and drain system of oil lubricated or oil mist lubricated motors

6.8 CONNECTION OF THE COOLING WATER SYSTEM

When water cooled motors are installed, connect the water inlet and outlet tubes to ensure proper motor cooling. According to item 7.2, ensure correct cooling water flow rate and water temperature in the motor cooling system.

6.9 ELECTRICAL CONNECTION

Consider the rated motor current, service factor, starting current, environmental and installation conditions, maximum voltage drop, etc. to select appropriate power supply cables and switching and protection devices.

All motors must be installed with overload protection systems. Three-phase motors should be fitted with phase fault protection systems.



Before connecting the motor, check if the power supply voltage and the frequency comply with the motor nameplate data. All wiring must be made according to the connection diagram on the motor nameplate. Please consider the connection diagrams in Table 12 as the reference value.

Please consider the connection diagrams in Table 12 as the reference value.

To prevent accidents, check if the motor has been solidly grounded in accordance with the applicable standards.

Table 12 - Typical connection diagram for three-phase motors.

Configuration	Quantity of Leads	Type of connection	Connection diagram																						
Single Speed	3	-																							
	6	Δ - Y																							
	9	YY - Y																							
		$\Delta\Delta$ - Δ																							
	12	$\Delta\Delta$ - YY - Δ - Y																							
Δ - PWS Part-winding start		<table border="0"> <tr> <th colspan="3">PART-WINDING</th> <th colspan="3">WYE-DELTA</th> </tr> <tr> <td>START</td> <td>RUN</td> <td></td> <td>START</td> <td>RUN</td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>L1 L2 L3</td> <td>L1 L2 L3</td> <td></td> <td>L1 L2 L3</td> <td>L1 L2 L3</td> <td></td> </tr> </table>	PART-WINDING			WYE-DELTA			START	RUN		START	RUN								L1 L2 L3	L1 L2 L3		L1 L2 L3	L1 L2 L3
PART-WINDING			WYE-DELTA																						
START	RUN		START	RUN																					
L1 L2 L3	L1 L2 L3		L1 L2 L3	L1 L2 L3																					
Double Speed Dahlander	6	YY - Y Variable Torque																							
		Δ - YY Constant Torque																							
		YY - Δ Constant Output																							
	9	Δ - Y - YY																							
Double Speed Double Winding	6	-																							

Table 13 - Equivalent table for lead identification

Equivalent table for lead identification													
Lead identification on the wiring diagram		1	2	3	4	5	6	7	8	9	10	11	12
Single Speed	NEMA MG 1 Part 2	T1	T2	T3	T4	T5	T6	T7	T8	T9	T10	T11	T12
	IEC 60034-8	U1	V1	W1	U2	V2	W2	U3	V3	W3	U4	V4	W4
Double Speed (Dahlander / Double Winding)	NEMA MG 1 Part 2 ¹⁾	1U	1V	1W	2U	2V	2W	3U	3V	3W	4U	4V	4W
	IEC 60034-8	1U	1V	1W	2U	2V	2W	3U	3V	3W	4U	4V	4W

1) NEMA MG 1 Part 2 defines T1 to T12 for two or more winding, however, WEG adopts 1U to 4W.

Connect the motor properly to the power supply by means of safe and permanent contacts.

The grounding connectors are provided inside the terminal box and on the motor frame. Upon request, grounding terminals may be also provided on the motor feet. According to IEC 60079-0, the grounding cable must have a cross-section area of at least 4 mm².



When connectors are used, all wires of the stranded cable must be properly inserted and fixed inside the connector.

ENGLISH

If motors are supplied without terminal blocks, insulate the cable terminals with suitable insulation material that meets the power supply voltage and the insulation class indicated on the motor nameplate. The connection must be made outside the hazardous area or protected by a standardized type of protection.

Ensure correct tightening torque for the power cable, grounding connections, cable-glands and the plugs as specified in Table 41 and Table 42.

The clearance distance (see Figure 42) between non-insulated live parts with each other and between grounded parts must be as indicated in Table 14.

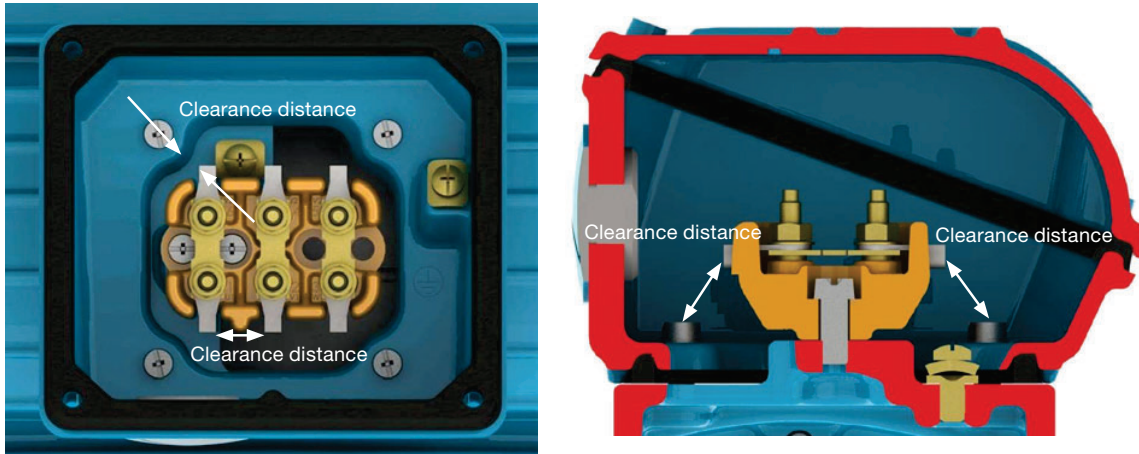


Figure 42 - Clearance distance representation

Table 14 - Minimum clearance distance (mm) x supply voltage.

Voltage	Minimum clearance distance (mm) x type of protection	
	Ex eb Ex db eb	Ex ec Ex db Ex tb Ex tc
$U \leq 440 \text{ V}$	6	4
$440 < U \leq 690 \text{ V}$	10	5.5
$690 < U \leq 1000 \text{ V}$	14	8
$1000 < U \leq 6900 \text{ V}$	60	45
$6900 < U \leq 11000 \text{ V}$	100	70
$11000 < U \leq 16500 \text{ V}$	-	105



Even when the motor is off, dangerous voltages may be present inside the terminal box used for the space heater supply or winding energization when the winding is used as a heating element.

Motor capacitors will hold a charge even after the power has been cut off. Do not touch the capacitors and/or motor terminals, before discharging the capacitors completely. For Magnet and WQuattro motors, even when the motor is disconnected from the power supply, there may be voltage in the motor's terminals if the rotor moves.



After the motor connection has been completed, ensure that no tool or foreign body has been left inside the terminal box.

The thread types and sizes for cable inlet are specified in Table 15 and Table 16.

Table 15 - Thread dimensions for inlet power cables.

Frame		Threads for power cables		
IEC	NEMA	Pg	NPT/Rp/Gk	Metric
-	EX61G	-	1/2"	-
63 71 80 90 100	143/5	Pg11 Pg13.5 Pg16	1/4" 1/2" 3/4"	M20 M25
112 132	182/4 213/5	Pg11 Pg13.5 Pg16 Pg21	1/2" 3/4" 1"	M20 M25 M32
160 180 200	254/6 284/6 324/6	Pg11 Pg13.5 Pg16 Pg21 Pg29 Pg36	1/2" 3/4" 1" 1 1/2"	M20 M25 M32 M40 M50
225 250 280 315 355 400 450 500 560 630	364/5 404/5 444/5 445/7 447/9 L447/9 504/5 5008 586/7 588/9 5800 6800 7000 8000 8800 9600	Pg29 Pg36 Pg42 Pg48	1" 1 1/2" 2" 2 1/2" 3" 4"	M32 M40 M50 M63 M72 M75 M80

Note: explosion-proof motors are supplied with Metric or NPT threads only.

Table 16 - Thread dimensions for accessory cable inlet.

Frame		Threads for accessory cables		
IEC	NEMA	Pg	NPT/Rp/Gk	Metric
All	All	Pg11 Pg13.5 Pg16 Pg21	1/4" 1/2" 3/4" 1"	M20 M25 M32 M40

Note: explosion-proof motors are supplied with Metric or NPT threads only.



Take the required measures in order to ensure the type of protection of enclosure (Ex), the equipment protection level (EPL) and the degree of protection (IP) indicated on the motor nameplate:

- Not-used cable inlet holes in the terminal boxes must be properly closed with certified plugs;
- components supplied loose (for example, terminal boxes mounted separately) must be properly closed and sealed.

The cable entries used must be fitted with components (such as, cable glands and conduits) that meet the applicable standards and regulations for each country. For "Ex db" motors, the conduit entries are permitted only for electrical equipment of group II.



If the motor is fitted with accessories, such as brakes and forced cooling systems, these devices must be connected to the power supply according to the information provided on their nameplates and with special care as indicated above.

All protection devices, including overcurrent protection, must be set according to the rated machine conditions. These protection devices must protect the machine against short circuit, phase fault or locked rotor condition. The motor protection devices intended for use in hazardous areas must be set according to the applicable standards. Delta connected motors must be protected against phase fault. To do that, connect the overload relay in series to the winding phases and set it to 0.58 times the rated current.

Check the direction of rotation of the motor shaft. If there is no limitation for the use of unidirectional fans, the shaft rotation direction can be changed by reversing any two of the phase connections. For single-phase motor, check the connection diagram indicated on the motor nameplate.

6.10 CONNECTION OF THE THERMAL PROTECTION DEVICES

If the motor is supplied with temperature monitoring devices, such as thermostat, thermistors, automatic thermal protectors, Pt-100 (RTD), etc., their connection must be done to the corresponding control devices as specified on the accessory nameplates. The non-compliance with this procedure may void the product warranty and cause serious material damages.

For “Ex ec”, “Ex db” or “Ex db eb” and “Ex tb” or “Ex tc” motors: all thermal protections (RTDs, bimetal thermal protectors and thermistors for stator protection) used in the motor protection circuit can be connected via a standard industrial controller located in a safe area.

For “Ex eb” motors: all thermal protections (RTDs, bimetal thermal protectors and thermistors for stator protection) used in the motor protection circuit must be separately protected by the use of an intrinsic safety supply that ensures the minimum EPL Gb level of protection.



For Class I & II Division 1 motors and/or motors driven by frequency inverters, the use of the thermal protection is mandatory (except for temperature classes T2B or higher).

For Division 2 or non-hazardous areas, the use of the thermal protection is optional.



Do not apply test voltage above 2.5 V on thermistors and current above 1 mA on RTDs (Pt-100) according to IEC 60751 standard.

Figure 43 and Figure 44 show the connection diagram of the bimetal thermal protector (thermostats) and thermistors, respectively.

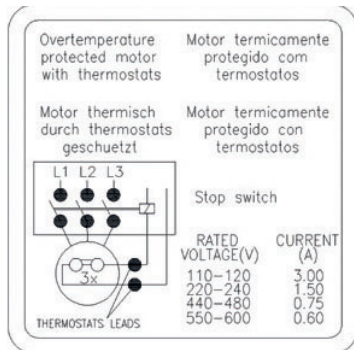


Figure 43 - Connection of the bimetal thermal protectors (thermostats)

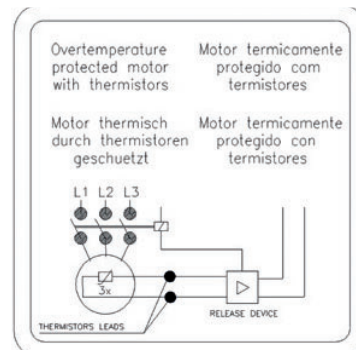


Figure 44 - Thermistor connection

In applications with protection by increased safety “Ex eb”, the protection device, in case of overload or locked rotor, must trip with time delay based on the current along with monitoring the three external leads. The time “ t_E ” indicated on the motor nameplate should not be exceeded.

If motors with protection by increased safety “Ex eb” are submitted to acceleration time $> 1.7 \times \text{time-}t_E$, they must be protected by protection devices against overcurrent.

Table 17 - Maximum activation temperature of the thermal protection.

Component	Marking for hazardous area on the motor nameplate	Hazardous area where the equipment will be installed	Max. operating temperature (°C)	
			Alarm	Tripping
Winding	Ex db	Ex db	130	150
	Ex ec	Ex ec	130	155
	Ex tb	Ex tb	120	140
	Ex tc	Ex tc	120	140
	Ex eb	Ex eb	-	110
	Ex ec + Ex tc	Ex ec	140	155
		Ex tc	-	140
	Ex db + Ex tb	Ex db	140	150
		Ex tb	-	140
	Class I Div. 1	Class I Div. 1	130	150
Class I Div. 2	Class I Div. 2	130	155	
Class II Div. 1	Class II Div. 1	120	140	
Bearing	All	All	110	120

Notes:

- 1) The number and type of the installed protection devices are stated on the accessory nameplate of the motor.
- 2) If the motor is supplied with calibrated resistance, (for example, Pt-100), the motor monitoring system must be set according to the operating temperatures indicated in Table 17.

The non-isolated part of the accessory cables should not exceed 1 mm up to the connector as shown in Figure 45.

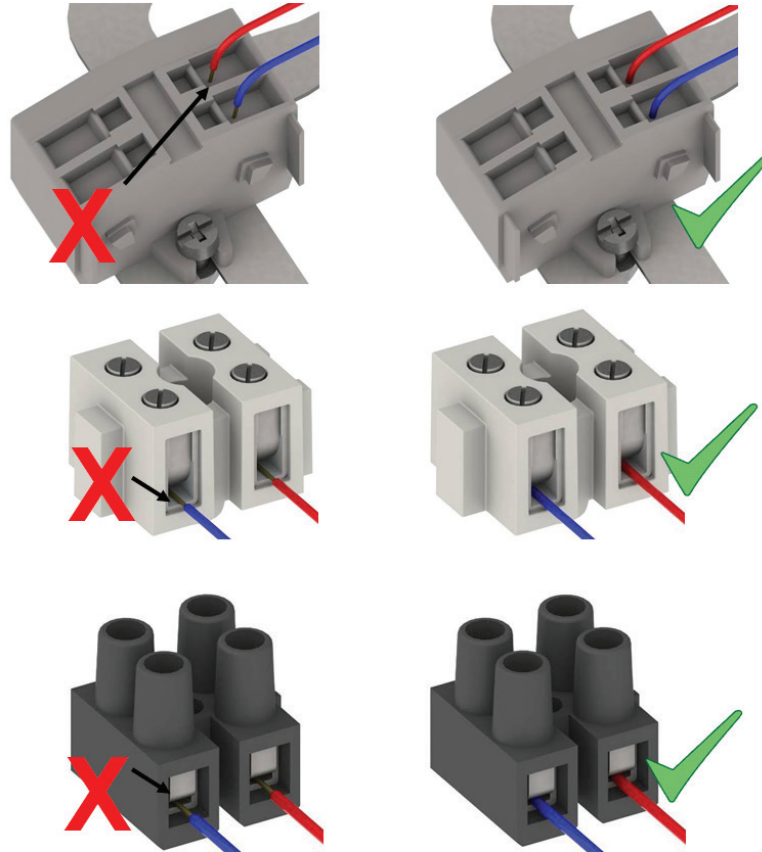


Figure 45 - Connection of the accessory cables to the connector.

6.11 RESISTANCE TEMPERATURE DETECTORS (PT-100)

The RTDs (Pt-100) are made of materials, whose resistance depends on the temperature variation, the intrinsic property of some materials (usually platinum, nickel or copper), calibrated resistance. Its operation is based on the principle that the electric resistance of a metallic conductor varies linearly with the temperature, thus allowing continuous monitoring of the motor warm-up through the controller display ensuring a high level of precision and answer stability. These devices are widely used for measuring temperatures in various industry sectors.

In general, these devices are used in installations where precise temperature control is required, for example, an installation for irregular or intermittent duty.

The same detector may be used for alarm and tripping purposes.

Table 18 and Figure 47 show the equivalence between the Pt-100 resistance and the temperature. The Figure 46 shows the connection of a winding Pt-100.

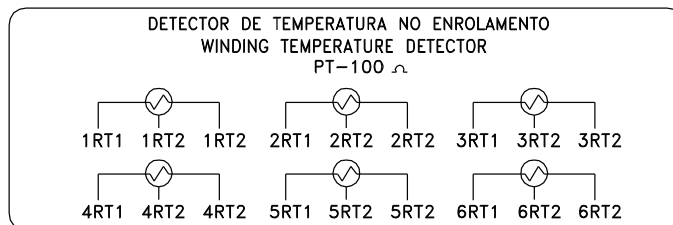


Figure 46 - Connection of winding Pt-100

Table 18 - Equivalence between the Pt-100 resistance and the temperature.

°C	Ω	°C	Ω	°C	Ω	°C	Ω	°C	Ω
-29	88.617	17	106.627	63	124.390	109	141.908	155	159.180
-28	89.011	18	107.016	64	124.774	110	142.286	156	159.553
-27	89.405	19	107.404	65	125.157	111	142.664	157	159.926
-26	89.799	20	107.793	66	125.540	112	143.042	158	160.298
-25	90.193	21	108.181	67	125.923	113	143.420	159	160.671
-24	90.587	22	108.570	68	126.306	114	143.797	160	161.043
-23	90.980	23	108.958	69	126.689	115	144.175	161	161.415
-22	91.374	24	109.346	70	127.072	116	144.552	162	161.787
-21	91.767	25	109.734	71	127.454	117	144.930	163	162.159
-20	92.160	26	110.122	72	127.837	118	145.307	164	162.531
-19	92.553	27	110.509	73	128.219	119	145.684	165	162.903
-18	92.946	28	110.897	74	128.602	120	146.061	166	163.274
-17	93.339	29	111.284	75	128.984	121	146.438	167	163.646
-16	93.732	30	111.672	76	129.366	122	146.814	168	164.017
-15	94.125	31	112.059	77	129.748	123	147.191	169	164.388
-14	94.517	32	112.446	78	130.130	124	147.567	170	164.760
-13	94.910	33	112.833	79	130.511	125	147.944	171	165.131
-12	95.302	34	113.220	80	130.893	126	148.320	172	165.501
-11	95.694	35	113.607	81	131.274	127	148.696	173	165.872
-10	96.086	36	113.994	82	131.656	128	149.072	174	166.243
-9	96.478	37	114.380	83	132.037	129	149.448	175	166.613
-8	96.870	38	114.767	84	132.418	130	149.824	176	166.984
-7	97.262	39	115.153	85	132.799	131	150.199	177	167.354
-6	97.653	40	115.539	86	133.180	132	150.575	178	167.724
-5	98.045	41	115.925	87	133.561	133	150.950	179	168.095
-4	98.436	42	116.311	88	133.941	134	151.326	180	168.465
-3	98.827	43	116.697	89	134.322	135	151.701	181	168.834
-2	99.218	44	117.083	90	134.702	136	152.076	182	169.204
-1	99.609	45	117.469	91	135.083	137	152.451	183	169.574
0	100.000	46	117.854	92	135.463	138	152.826	184	169.943
1	100.391	47	118.240	93	135.843	139	153.200	185	170.313
2	100.781	48	118.625	94	136.223	140	153.575	186	170.682
3	101.172	49	119.010	95	136.603	141	153.950	187	171.051
4	101.562	50	119.395	96	136.982	142	154.324	188	171.420
5	101.953	51	119.780	97	137.362	143	154.698	189	171.789
6	102.343	52	120.165	98	137.741	144	155.072	190	172.158
7	102.733	53	120.550	99	138.121	145	155.446	191	172.527
8	103.123	54	120.934	100	138.500	146	155.820	192	172.895
9	103.513	55	121.319	101	138.879	147	156.194	193	173.264
10	103.902	56	121.703	102	139.258	148	156.568	194	173.632
11	104.292	57	122.087	103	139.637	149	156.941	195	174.000
12	104.681	58	122.471	104	140.016	150	157.315	196	174.368
13	105.071	59	122.855	105	140.395	151	157.688	197	174.736
14	105.460	60	123.239	106	140.773	152	158.061	198	175.104
15	105.849	61	123.623	107	141.152	153	158.435	199	175.472
16	106.238	62	124.007	108	141.530	154	158.808	200	175.840

ENGLISH

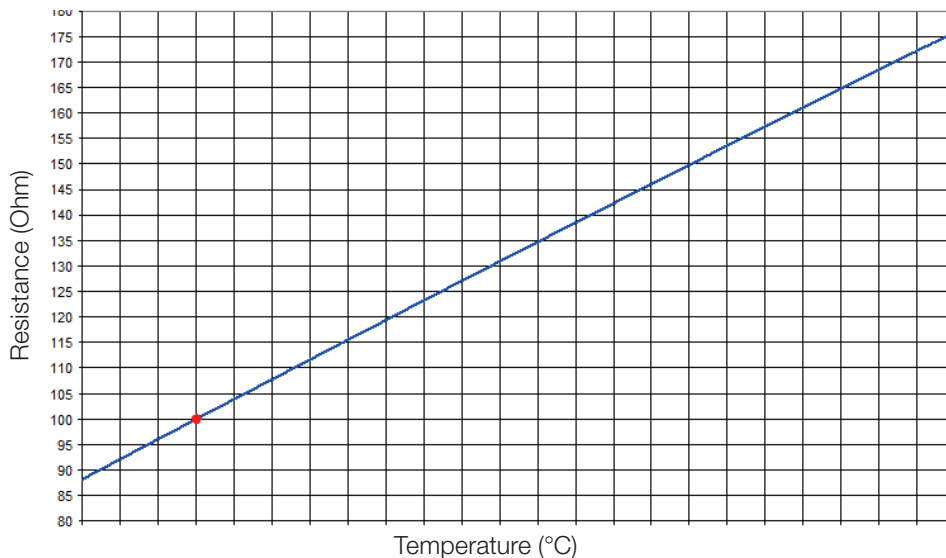


Figure 47 - Ohmic resistance of the Pt-100 x temperature

6.12 CONNECTION OF THE SPACE HEATERS

Before switching ON the space heaters, check if the space heaters connection has been made according to the connection diagram shown on the space heater nameplate. For motors supplied with dual voltage space heaters (110-127/220-240 V), see Figure 48.

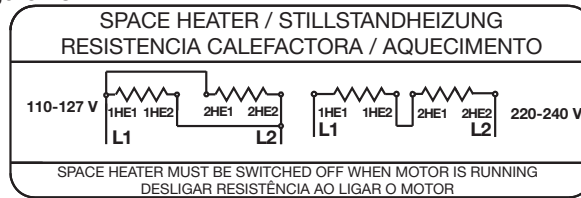


Figure 48 - Dual voltage space heater connection.



The space heaters should never be energized when the motor is in operation.

6.13 STARTING METHODS

Whenever possible, the motor starting must be Direct On Line (DOL) at rated voltage. This is the most simple and feasible starting method. However, it must only be applied when the starting current does not affect the power supply. Please consider the local electric utility regulations when installing a motor.

High inrush current may result in:

- a) high voltage drop in the power supply line creating unacceptable line disturbance on the distribution system; b) requiring oversized protection system (cables and contactor) increasing the installation costs.

If DOL starting is not allowed due to the reasons mentioned above, an indirect starting method compatible with the load and motor voltage to reduce the starting current may be used.

If reduced voltage starters are used for starting, the motor starting torque will also be reduced.

Table 19 shows the possible indirect starting methods that can be used depending on the number of the motor leads.

Table 19 - Starting method x number of motor leads.

Number of leads	Possible starting methods
3 leads	Autotransformer Soft-starter
6 leads	Star-Delta Autotransformer Soft-Start
9 leads	Star-Delta Series/Parallel Part Winding Autotransformer Soft-Start
12 leads	Star-Delta Series/Parallel Part Winding Autotransformer Soft-Start

Table 20 shows examples of possible indirect starting methods to be used according to the voltage indicated on the motor nameplate and the power supply voltage.

Table 20 - Starting methods x voltage

Nameplate voltage	Operating voltage	Star-delta	Autotransformer Starting	Part Winding Starting	Starting by series/parallel switch	Starting by soft-starter
220/380 V	220 V	YES	YES	NO	NO	YES
	380 V	NO	YES	NO	NO	YES
220/440 V	220 V	NO	YES	YES	YES	YES
	440 V	NO	YES	NO	NO	YES
230/460 V	230 V	NO	YES	YES	YES	YES
	460 V	NO	YES	NO	NO	YES
380/660 V	380 V	YES	YES	NO	NO	YES
220/380/440 V	220 V	YES	YES	YES	YES	YES
	380 V	NO	YES	YES	YES	YES
	440 V	YES	YES	NO	NO	YES

The starting by frequency inverter may be another starting method to avoid overloading the power supply line. For more information about the motor control by frequency inverter, see item 6.14.

6.14 MOTORS DRIVEN BY FREQUENCY INVERTER



The operation with frequency inverter must be stated in the Purchase Order since this drive type may require some changes in the motor design.



Motors driven by frequency inverters must have their winding thermal protections connected.



Magnet Motors must only be driven by frequency inverter. The WQuattro line motors must be started direct-on-line (DOL) or driven by a frequency inverter in scalar mode.

The frequency inverter used to drive motors up to 690 V must be fitted with Pulse With Modulation (PWM) with vector control.

Motors driven by frequency inverters have an additional nameplate fixed on the motor frame indicating the Service Factor, inverter type, frame size, and/or load type (constant or variable torque) as a function of the speed range and motor torque.

When a motor is driven by a frequency inverter at lower frequencies than the rated frequency, you must reduce the motor torque to prevent motor overheating. The torque reduction (derating torque) can be found in item 6.4 of the “Technical Guidelines for Induction Motors driven by PWM Frequency inverters” available on the site www.weg.net. If the motor is operated above the rated frequency, please note:

- That the motor must be operated at the constant output;
- That the motor can supply max. 95% of its rated output;
- Do not exceed the maximum speed and please consider:
 - max. operating frequency informed on the additional nameplate;
 - mechanical speed limit of the motor.

The “Ex ec” motor line driven by frequency inverter (used in Zone 2 – presence of gas) can be operated up to the limit of the Temperature Class T3 (200 °C).

The “Ex tc” and “Ex tb” motor line driven by frequency inverter (used in Zone 22 and Zone 21 - in the presence of combustible dust) can be operated up to the temperature limit of 125 °C.

For Magnet motors driven by non-WEG inverters, in addition to the speed limit stated in the motor data sheet, the maximum permitted speed limit must be checked to avoid burning the inverter in the event of a power failure. It should be considered according to the equation below:

$$RPM_{max} = 0.9 * \frac{V_{rmsMax} * 1000}{k_e}$$

Being,

RPM_{max} – Maximum speed allowed to avoid burning the inverter in the event of a power failure in [RPM].

V_{rmsMax} – Maximum input rms voltage of the inverter, as informed by the inverter manufacturer in [V].

k_e – Parameter informed on the nameplate and in the motor data sheet in [V / kRPM].

Information on the selection of the power cables between the frequency inverter and the motor can be found in item 6.8 of the “Technical Guidelines for Induction Motors driven by PWM Frequency inverters” available at www.weg.net.

6.14.1 Use of dV/dt filter

6.14.1.1 Motor with enameled round wire

Motors designed for rated voltages up to 690 V, when driven by frequency inverter, do not require the use of dV/dT filters, provided that following criteria are considered.

Table 21 - Criteria for the selection of motors with round enameled wire when driven by frequency inverter

Criteria for the selection of motors with round enameled wire when driven by frequency inverter				
Motor rated voltage ^{1 2}	Peak voltage at the motor terminals (max)	dV/dt inverter output (max)	Inverter Rise Time ² (min.)	MTBP ² Time between pulses (min)
Vnom < 460 V	≤ 1600 V	≤ 5200 V/μs	≥ 0,1 μs	≥ 6 μs
460 ≤ Vnom < 575 V	≤ 2000 V	≤ 6500 V/μs		
575 ≤ Vnom ≤ 1000 V	≤ 2400 V	≤ 7800 V/μs		

Notes:

1. For the application of dual voltage motors, for example 380/660 V, consider the lower voltage (380 V).

2. Information supplied by the inverter manufacturer.

6.14.1.2 Motor with prewound coils

Motors with pre-wound coils (medium and high voltage motors regardless of frame sizes, and low voltage motors from IEC 500 / NEMA 800 frame on), designed for the use with frequency inverters, do not require the use of filters, provided they comply with the criteria in Table 22.

Table 22 - Criteria to be considered when using the motor with pre-wound coils to be driven by frequency inverters

Motor rated voltage	Type of modulation	Turn to turn insulation (phase-phase)		Phase-ground insulation	
		Peak voltage at the motor terminals	dV/dt at the motor terminals	Peak voltage at the motor terminals	dV/dt at the motor terminals
690 < V _{nom} ≤ 4160 V	Sinusoidal	≤ 5900 V	≤ 500 V/μs	≤ 3400 V	≤ 500 V/μs
	PWM	≤ 9300 V	≤ 2700 V/μs	≤ 5400 V	≤ 2700 V/μs
4160 < V _{nom} ≤ 6600 V	Sinusoidal	≤ 9300 V	≤ 500 V/μs	≤ 5400 V	≤ 500 V/μs
	PWM	≤ 14000 V	≤ 1500 V/μs	≤ 8000 V	≤ 1500 V/μs

6.14.2 Bearing insulation

Only the motors in IEC frame size 400 (NEMA 680) and larger are supplied, as standard, with insulated bearing. If the motor must be driven by frequency inverter, insulate the bearing according to Table 23.

Table 23 - Recommendation on the bearing insulation for inverter driven motors

Frame size	Recommendation
IEC 315 and 355 NEMA L447/9, 504/5, 5006/7/8, 5009/10/11, 586/7, 5807/8/9, 5810/11/12 and 588/9	One bearing is isolated
IEC 400 and higher NEMA 680 and higher	NDE-bearing is isolated



The shaft grounding system for explosion-proof motors can be used only inside the enclosure. For other types of protection, the shaft grounding system is not allowed.

6.14.3 Switching Frequency

The minimum inverter switching frequency must not be lower than 2 kHz and should not exceed 5 kHz.



The non-compliance with the criteria and recommendations indicated in this manual may void the product warranty.



The use of sparking components, such as grounding brushes, is not allowed in explosive atmospheres.

6.14.4 Mechanical speed limitation

Table 24 shows the maximum speeds allowed for motors driven by frequency inverter. For Magnet motors, see the motor's data sheet or contact WEG.

Table 24 - Maximum motor speed (in rpm).

Frame size		DE-bearing	Maximum speed for standard motors	
IEC	NEMA			
63-90	143/5	6201 6202 6203 6204 6205	10400	
100	-	6206	8800	
112	182/4	6207	7600	
		6307	6800	
132	213/5	6308	6000	
160	254/6	6309	5300	
180	284/6	6311	4400	
225-630	364/5-9610	200	6312	4200
			6314	3600
			6315	3600
			6316	3200
			6218	3600
			6319	3000
			6220	3600
			6320	2200
			6322	1900
			6324	1800
			6328	1800
	6330	1800		

Note:

To select the maximum allowed motor speed, consider the motor torque derating curve and the maximum operating frequency stated on the product certificate.

For more information on the application of frequency inverters, contact WEG or check the “Technical Guidelines for Induction Motors driven by PWM Frequency inverters” available at www.weg.net.

7. COMMISSIONING

7.1 INITIAL START-UP

After finishing the installation procedures and before starting the motor for the first time or after a long period without operation, the following items must be checked:

- If the nameplate data (voltage, current, connection diagram, degree of protection, type of protection, cooling system, service factor, etc.) meet the application requirements.
- If the machine set (motor + driven machine) has been mounted and aligned correctly.
- If the motor driving system ensures that the motor speed does not exceed the max. allowed speed indicated in Table 24.
- Measure the winding insulation resistance, making sure it complies with the specified values in item 5.4.
- Check the motor rotation direction.
- Inspect the motor terminal box for damage and ensure that it is clean and dry and all contacts are rust-free, the seals are in perfect operating conditions and all unused threaded holes are properly closed thus ensuring the degree of protection and the type of protection of the motor indicated on the motor nameplate.
- Check if the motor wiring connections, including grounding and auxiliary equipment connection, have been carried out properly and are in accordance with the recommendations in item 6.9.
- Check the operating conditions of the installed auxiliary devices (brake, encoder, thermal protection device, forced cooling system, etc.).
- Check the bearings operating conditions. If the motors are stored and/or installed for more than two years without running, it is recommended to change the bearings or to remove, wash, inspect and relubricate them before the motor is started. If the motor is stored and/or installed according to the recommendations described in item 5.3, lubricate the bearings as described in item 8.2. For the bearing condition evaluation, it is recommended to use of the vibration analysis techniques: Envelope Analysis or Demodulation Analysis.
- When motors are fitted with sleeve bearings, ensure:

- correct oil level for the sleeve bearing. The oil level should be in the center of the sight glass (see Figure 37);
- that the motor is not started or operated with axial or radial loads;
- that if the motor is stored for a period equal or longer than the oil change interval, the oil must be changed before starting the motor.
- Inspect the capacitor operating condition, if any. If motors are installed for more than two years, but were never commissioned, it is recommended to change the start capacitors since they lose their operating characteristics.
- Ensure that the air inlet and outlet opening are not blocked. The minimum clearance to the nearest wall (L) should be at least ¼ of the fan cover diameter (D), see Figure 49. The intake air temperature must be at ambient temperature.

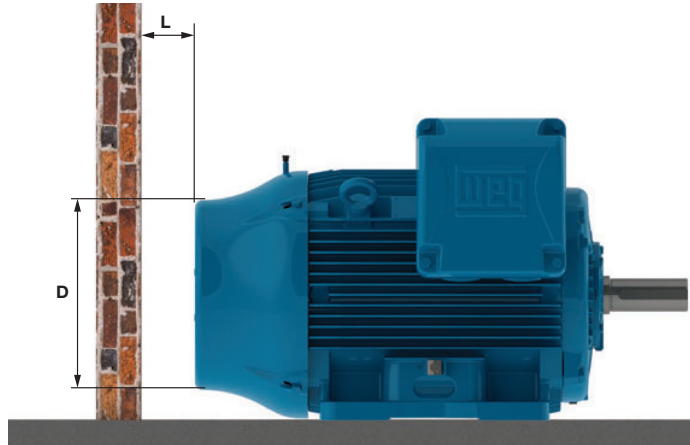


Figure 49 - Minimum clearance to the wall

Please consider the minimum distances shown in Table 25 as the reference value.

Table 25 - Minimum distance between the fan cover and wall

Frame size		Distance between the fan cover and the wall (L)	
IEC	NEMA	mm	inches
63	-	25	0.96
71	-	26	1.02
80	-	30	1.18
90	143/5	33	1.30
100	-	36	1.43
112	182/4	41	1.61
132	213/5	50	1.98
160	254/6	65	2.56
180	284/6	68	2.66
200	324/6	78	3.08
225	364/5	85	3.35
250	404/5		
280	444/5	108	4.23
	445/7		
	447/9		
315	L447/9	122	4.80
	504/5		
	5006/7/8		
	5009/10/11		
355	586/7	136	5.35
	588/9		
	5807/8/9		
	5810/11/12		
400	6806/7/8	147	5.79
	6809/10/11		
450	7006/10	159	6.26
500	8006/10	171	6.73
560	8806/10	185	7.28
630	9606/10	200	7.87

- Ensure the correct water flow rate and water temperature when water cooled motors are used. See item 7.2.
- Ensure that all rotating parts, such as pulleys, couplings, external fans, shaft, etc. are protected against accidental contact.

Other tests and inspections not included in the manual may be required, depending on the specific installation, application and/or motor characteristics.

After all previous inspections have been carried out, proceed as follows to start the motor:

- Start the motor on no-load (if possible) and check the motor direction of rotation. Check for the presence of any abnormal noise, vibration or other abnormal operating conditions.
- Ensure the motor starts smoothly. If any abnormal operating condition is noticed, switch off the motor, check the assembly system and connections before the motor is started again.
- If excessive vibrations are noticed, check if the motor mounting bolts are well tightened or if the vibrations are not generated and transmitted from adjacent installed equipment. Check the motor vibration periodically and ensure that the vibration limits are as specified in item 7.2.1.
- Start the motor at rated load during a short time and compare the operating current with the rated current indicated on the nameplate.
- Continue to measure the following motor variables until thermal equilibrium is reached: current, voltage, bearing and motor frame temperature, vibration and noise levels.
- Record the measured current and voltage values on the Installation Report for future comparisons.

As induction motors have high inrush currents during start-up, the acceleration of high inertia load requires an extended starting time to reach full speed resulting in fast motor temperature rise. Successive starts within short intervals will result in winding temperature increases and can lead to physical insulation damage reducing the useful life of the insulation system. If the duty S1 is specified on the motor nameplate, this means that the motor has been designed for:

- two successive starts: first start from the cold condition, i. e., the motor windings are at room temperature and the second start immediately after the motor stops.
- one start from the hot condition, i. e., the motor windings are at rated temperature.

The Troubleshooting Chart in Section 10 provides a basic list of unusual cases that may occur during motor operation with the respective corrective actions.

7.2 OPERATING CONDITIONS

Unless otherwise stated in the Purchase Order, electric motors are designed and built to be operated at altitudes up to 1000 meters above sea level and in a temperature range from -20 °C to +40 °C. Any deviation from the normal condition of motor operation must be stated on the motor nameplate. Some components must be changed if the ambient temperature is different from the specified one. Please contact WEG to check the required special features. For operating temperatures and altitudes differing from those above, the factors indicated in Table 26 must be applied to the nominal motor power rating in order to determine the derated available output ($P_{max} = P_{nom} \times$ correction factor).

Table 26 - Correction factors for altitude and ambient temperature.

T (°C)	Altitude (m)								
	1000	1500	2000	2500	3000	3500	4000	4500	5000
10							0.97	0.92	0.88
15						0.98	0.94	0.90	0.86
20					1.00	0.95	0.91	0.87	0.83
25				1.00	0.95	0.93	0.89	0.85	0.81
30			1.00	0.96	0.92	0.90	0.86	0.82	0.78
35		1.00	0.95	0.93	0.90	0.88	0.84	0.80	0.75
40	1.00	0.97	0.94	0.90	0.86	0.82	0.80	0.76	0.71
45	0.95	0.92	0.90	0.88	0.85	0.81	0.78	0.74	0.69
50	0.92	0.90	0.87	0.85	0.82	0.80	0.77	0.72	0.67
55	0.88	0.85	0.83	0.81	0.78	0.76	0.73	0.70	0.65
60	0.83	0.82	0.80	0.77	0.75	0.73	0.70	0.67	0.62
65	0.79	0.76	0.74	0.72	0.70	0.68	0.66	0.62	0.58
70	0.74	0.71	0.69	0.67	0.66	0.64	0.62	0.58	0.53
75	0.70	0.68	0.66	0.64	0.62	0.60	0.58	0.53	0.49
80	0.65	0.64	0.62	0.60	0.58	0.56	0.55	0.48	0.44

Motors installed inside enclosures (cubicles) must be ensured an air renewal rate in the order of one cubic meter per second for each 100 kW installed power or fraction of installed power. Totally Enclosed Air Over motors - TEAO (fan and exhaust/smoke extraction) are supplied without cooling fan and the manufacturer of the driven machine is responsible for sufficient motor cooling. If no minimum required air speed between motor fins is indicated on the motor nameplate, ensure the air speed indicated in Table 27 is provided. The values shown in Table 27 are valid for 60 Hz motors. To obtain the minimum air speed for 50 Hz motors, multiply the values in table by 0.83.

Table 27 - Minimum required air speed between motor fins (metres/second).

Frame		Poles			
IEC	NEMA	2	4	6	8
63 to 90	143/5	13	7	5	4
100 to 132	182/4 to 213/5	18	12	8	6
160 to 200	254/6 to 324/6	20	15	10	7
225 to 280	364/5 to 444/5	22	20	15	12
315 to 450	445/7 to 7009/10	25	25	20	15

The voltage and frequency variations may affect the performance characteristics and the electromagnetic compatibility of the motor. The power supply variations should not exceed the values specified in the applicable standards. Examples:

- ABNT NBR 17094 - Parts 1 and 2. The motor has been designed to supply the rated torque for a combined variation in voltage and frequency:
 - Zone A: $\pm 5\%$ of the rated voltage and $\pm 2\%$ of the rated frequency.
 - Zone B: $\pm 10\%$ of the rated voltage and $+3\%$ -5% of the rated frequency.

When operated continuously in Zone A or B, the motor may show performance variations and the operating temperature may increase considerably. These performance variations will be higher in Zone B. Thus it is not recommended to operate the motor in Zone B during extended periods.

- IEC 60034-1. The motor has been designed to supply the rated torque for combined variation in voltage and frequency:
 - Zone A: $\pm 5\%$ of the rated voltage and $\pm 2\%$ of the rated frequency.
 - Zone B: $\pm 10\%$ of the rated voltage and $+3\%$ -5% of the rated frequency.

When operated continuously in Zone A or B, the motor may show performance variations and the operating temperature may increase considerably. These performance variations will be higher in Zone B. Thus it is not recommended to operate the motor in Zone B during extended periods. For multi-voltage motors (example 380-415/660 V), a $\pm 5\%$ voltage variation from the rated voltage is allowed.

- NEMA MG 1 Part 12. The motor has been designed to be operated in one of the following variations:
 - $\pm 10\%$ of the rated voltage, with rated frequency;
 - $\pm 5\%$ of the rated frequency, with rated voltage;
 - A combined variation in voltage and frequency of $\pm 10\%$, provided the frequency variation does not exceed $\pm 5\%$.

If the motor is cooled by ambient air, clean the air inlet and outlet openings and cooling fins at regular intervals to ensure a free airflow over the frame surface. The hot air should never be returned to the motor. The cooling air must be at room temperature limited to the temperature range indicated on the motor nameplate (if no room temperature is specified, please consider a temperature range between $-20\text{ }^{\circ}\text{C}$ and $+40\text{ }^{\circ}\text{C}$).

Table 28 shows the minimum required water flow for water-cooled motors considering the different frame sizes and the maximum allowed temperature rise of the cooling water after circulating through the motor. The inlet water temperature should not exceed $40\text{ }^{\circ}\text{C}$.

Table 28 - Minimum required water flow and the maximum allowed temperature rise of the cooling water after circulating through the motor

Frame size		Flow rate (litres/minute)	Maximum allowed water temperature rise ($^{\circ}\text{C}$)
IEC	NEMA		
180	284/6	12	5
200	324/6	12	5
225	364/5	12	5
250	404/5	12	5
280	444/5	15	6
	445/7		
	447/9		
315	504/5	16	6
355	586/7	25	6
	588/9		

For W60 motors, please see the nameplate at heat-exchanger.

Motors fitted with oil mist lubrication systems can be operated continuously for a maximum of one hour after the failure of the oil pumping system.

Considering the sun's heat increases the operating temperature, externally mounted motors must always be

protected from direct sunlight exposure.

Each and every deviation from the normal operating condition (tripping of the thermal protection, noise and vibration level increase, temperature and current rise) should be investigated and corrected by WEG Authorized Service Centers for explosive atmospheres.



Motors fitted with cylindrical roller bearings require a minimum radial load to ensure normal operation. For information regarding the radial preload, please contact WEG.

7.2.1 Limits of vibration

The vibration severity is the maximum vibration value measured at all positions and in all directions as recommended in the standard IEC 60034-14. Table 29 specifies the limits of the maximum vibrations magnitudes according to standard IEC 60034-14 for shaft heights IEC 56 to 400, for vibrations grades A and B. The vibration severity limits in Table 29 are given as RMS values (Root Mean Square values or effective values) of the vibration speed in mm/s measured in free suspension condition.

Table 29 - Limits of maximum vibration magnitude according to standard IEC 60034-14

Shaft height [mm]	$56 \leq H \leq 132$	$132 \leq H \leq 280$	$H > 280$
Vibration Grade	Vibration severity on elastic base [mm/s RMS]		
A	1.6	2.2	2.8
B	0.7	1.1	1.8

Notes:

1 - The values in Table 29 are valid for measurements carried out with decoupled machines (without load) operated at rated voltage and frequency.

2 - The values in Table 29 are valid regardless of the direction of rotation of the machine.

3 - The values in Table 29 are not applicable to single-phase motors, three-phase motors powered by a single-phase system or to machines mounted in situ or coupled with inertia flywheels or to loads.

According to NEMA MG 1, the allowed vibration limit for standard motors is 0.15 in/s (peak vibration in in/s).

Note:

For the load operation condition, the use of the standard ISO 10816-3 is recommended for evaluating the motor vibration limits. In the load condition, the motor vibration will be influenced by several factors, such as type of the coupled load, condition of the motor fixation, alignment condition under load, structure or base vibration due to other pieces of equipment, etc.

8. MAINTENANCE

The purpose of the maintenance is to extend the useful life of the equipment. The non-compliance with one of these previous items can cause unexpected machine failures.

If motors with a cylindrical roller or angular contact bearings are to be transported during the maintenance procedures, the shaft locking device must always be fitted. All HGF, W50, W60 and W51 HD motors, regardless of the bearing type, must always be transported with the shaft locking device fitted.

All repairs, disassembly, and assembly related services must be carried out only by qualified and well-trained personnel by using proper tools and techniques. Make sure that the machine has stopped and it is disconnected from the power supply, including the accessory devices (space heater, brake, etc.), before any servicing is undertaken.

The company does not assume any responsibility or liability for repair services or maintenance operations to motor for use in hazardous areas executed by non-authorized Service Centers or by non qualified service personnel. The company shall have no obligation or liability whatsoever to the buyer for any indirect, special, consequential or incidental loss or damage caused or arising from the company's proven negligence.



Pacemaker users and unqualified personnel shall not open Magnet and WQuattro motors, because high energy magnets are used.

Repairs to motor for use in hazardous areas must be executed in accordance with the applicable standards.

8.1 GENERAL INSPECTION

The inspection intervals depend on the motor type, application and installation conditions. Proceed as follows during inspection:

- Visually inspect the motor and coupling. Check if abnormal noises, vibrations, excessive heating, wear signs, misalignment or damaged parts are noticed. Replace the damaged parts as required.
- Measure the insulation resistance according to item 5.4.

- Clean the motor enclosure. Remove oil spills and dust accumulation from the motor frame surface to ensure a better heat transfer to the surrounding ambient. Motors with potential risk for electrostatic charge accumulation, duly identified, must be cleaned carefully by using a damp cloth to prevent electrostatic discharge during maintenance interventions.
- Check cooling fan condition and clean the air inlet & outlet openings to ensure a free air flow over the motor.
- Investigate the actual condition of the seals and replace them, if required.
- Drain the condensed water from inside the motor. After draining, reinstall the drain plugs to ensure the degree of protection as indicated on the motor nameplate. The motor must always be positioned so the drain hole is at the lowest position (see item 6).
- Check the connections of the power supply cables, ensuring the correct clearance distance between live and grounded parts, as specified in Table 12.
- Check if the tightening torque of the bolted connections and mounting bolts meets the tightening torque specified in Table 41.
- Check the status of the cable passages, the cable gland seals and the seals inside the terminal box and replace them, if required.
- Check the bearing operating conditions. Check for the presence of any abnormal noise, vibration or other abnormal operating conditions, like motor temperature rise. Check the oil level, the lube oil condition and compare the workings hours with the informed life time.
- For explosion-proof motors check if the gap between the components is according to Table 40. The tolerance class of the metric threads for the cable inlet must be 6H or better.
- Record and file all changes performed on the motor.



Do not reuse damaged or worn parts. Damaged or worn parts must be replaced by parts supplied by the manufacturer and must be installed as if they were the original parts.

8.2 LUBRICATION

Proper lubrication plays a vital role in motor performance. Only use the grease or oil types, amounts and lubrication intervals recommended for the bearings. This information is available on the motor nameplate and the lubrication procedures must be carried out according to the type of lubricant (oil or grease).

When the motor is fitted with thermal protection devices for bearing temperature control, consider the operating temperature limits shown in Table 14.

The maximum operating temperature of motors used in special applications may differ from those shown in Table 14. The grease and oil disposal should be made in compliance with applicable laws in each country.



Please contact WEG when motors are to be installed in special environments or used for special applications.

8.2.1 Grease lubricated rolling bearings



Excess grease causes bearing overheating, resulting in bearing failure.

The lubrication intervals specified in Table 30, Table 31, Table 32, Table 33, Table 34, Table 35, Table 36 and Table 37 consider an absolute temperature on the bearing of 70 °C (up to frame size IEC 200 / NEMA 324/6) and 85 °C (for frame size IEC 225 / NEMA 364/5 and above) the motor running at rated speed, a motor mounted in horizontal position, greased with Mobil Polyrex EM grease. Any variation of the parameters listed above must be evaluated.



Table 30 - Lubrication intervals for deep groove ball bearings.

Frame		Poles	Bearing designation	Amount of grease (g)	Lubrication intervals (hours)			
					W21Xdb TEFC (Totally Enclosed Fan Cooled)		W22/W22Xdb TEFC (Totally Enclosed Fan Cooled)	
IEC	NEMA							
90	143/5	2	6205	4				
		4						
		6						
		8						
100	-	2	6206	5				
		4						
		6						
		8						
112	182/4	2	6207/ 6307	9				
		4						
		6						
		8						
132	213/5	2	6308	11	20000	20000	25000	
		4						
		6						
		8						
160	254/6	2	6309	13				
		4						
		6						
		8						
180	284/6	2	6311	18				
		4						
		6						
		8						
200	324/6	2	6312	21				
		4						
		6						
		8						
225 250 280 315 355	364/5 404/5 444/5 445/7 447/9 L447/9 504/5 5008 5010/11 586/7 588/9	2	6314	27	4500	3600	5000	4000
		4			11600	9700	14000	12000
		6			16400	14200	20000	17000
		8			19700	17300	24000	20000
		2	6316	34	3500	Upon request	4000	Upon request
		4			10400	8500	13000	10000
		6			14900	12800	18000	16000
		8			18700	15900	20000	20000
		2	6319	45	2400	Upon request	3000	Upon request
		4			9000	7000	11000	8000
		6			13000	11000	16000	13000
		8			17400	14000	20000	17000
4	6322	60	7200	5100	9000	6000		
6			10800	9200	13000	11000		
8			15100	11800	19000	14000		

Table 31 - Lubrication intervals for cylindrical roller bearings

Frame		Poles	Bearing designation	Amount of grease (g)	Lubrication intervals (hours)					
					W21 TEFC (Totally Enclosed Fan Cooled)		W22 TEFC (Totally Enclosed Fan Cooled)			
IEC	NEMA									
160	254/6	2	NU309	13	13300	9800	16000	12000		
		4			20000	20000	25000	25000		
		6								
		8								
180	284/6	2	NU311	18					9200	6400
		4			20000	19100	25000	25000		
		6			20000	20000				
		8								
200	324/6	2	NU312	21					7600	5100
		4					20000	20000	25000	25000
		6								
		8								
225 250 280 315 355	364/5 404/5 444/5 445/7 447/9 L447/9 504/5 5008 5010/11 586/7 588/9	4	NU314	27	8900	7100				
		6			13100	11000	16000	13000		
		8			16900	15100	20000	19000		
		4			NU316	34	7600	6000	9000	7000
		6	11600	9500			14000	12000		
		8	15500	13800			19000	17000		
		4	NU319	45			6000	4700	7000	5000
		6			9800	7600	12000	9000		
		8			13700	12200	17000	15000		
		4			NU322	60	4400	3300	5000	4000
		6	7800	5900			9000	7000		
		8	11500	10700			14000	13000		

Table 32 - Lubrication intervals for deep groove ball bearings – HGF line.

Frame		Poles	Bearing designation	Amount of grease (g)	Lubrication intervals (hours)	
IEC	NEMA				50 Hz	60 Hz
315L/A/B and 315C/D/E	5006/7/8T and 5009/10/11T	2	6314	27	3100	2100
		4 - 8	6320	50	4500	4500
355L/A/B and 355C/D/E	5807/8/9T and 5810/11/12T	2	6314	27		
		4 - 8	6322	60	4500	4500
			6319	45		
400L/A/B and 400 C/D/E	6806/7/8T and 6809/10/11T	2	6315	30	2700	1800
		4 - 8	6324	72	4500	4500
			6319	45		
450	7006/10	2	6220	31	2500	1400
		4	6328	93	4500	3300
			6322	60		
		6 - 8	6328	93	4500	4500
			6322	60		
500	8006/10	4	6330	104	4200	2800
			6324	72		
		6 - 8	6330	104	4500	4500
			6324	72		
560	8806/10	4 - 8	Upon request			
630	9606/10					

Table 33 - Lubrication intervals for cylindrical roller bearings – HGF line

Frame		Poles	Bearing designation	Amount of grease (g)	Lubrication intervals (hours)		
IEC	NEMA				50 Hz	60 Hz	
315L/A/B and 315C/D/E	5006/7/8 and 5009/10/11	4	NU320	50	4300	2900	
		6 - 8			4500	4500	
355L/A/B and 355C/D/E	5807/8/9 and 5810/11/12	4	NU322	60	3500	2200	
		6 - 8			4500	4500	
400L/A/B and 400C/D/E	6806/7/8 and 6809/10/11	4	NU324	72	2900	1800	
		6 - 8			4500	4500	
					2000	1400	
450	7006/10	4	NU328	93	4500	3200	
		6			4500	4500	
		8			1700	1000	
		4			4100	2900	
500	8006/10	6	NU330	104	4500	4500	
		8			2600	1600	
		4			4500	4500	
560	8806/10	4	NU228 + 6228	75	2600	1600	
		6 - 8			106	4500	4500
630	9606/10	4	NU232 + 6232	140	92	1000	
		6			120	4300	3100
		8			4500	4500	
		4			4500	4500	

Table 34 - Lubrication intervals for ball bearings - W50 line

	Frame		Poles	D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)		N.D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)	
	IEC	NEMA				50 Hz	60 Hz			50 Hz	60 Hz
Horizontal mounting Ball bearings	315 H/G	5009/10	2	6314	27	4500	3500	6314	27	4500	3500
			4 - 8	6320	50		4500	6316	34		4500
	355 J/H	5809/10	2	6314	27	4500	3500	6314	27	4500	3500
			4 - 8	6322	60		4500	6319	45		4500
	400 L/K and 400 J/H	6806/07 and 6808/09	2	6218	24	3800	2500	6218	24	3800	1800
			4 - 8	6324	72	4500	4500	6319	45	4500	4500
450 L/K and 450 J/H	7006/07 and 7008/09	2	6220	31	3000	2000	6220	31	3000	2000	
		4	6328	93	4500	3300	6322	60	4500	4500	
6 - 8	4500										
Vertical mounting Ball bearings	315 H/G	5009/10	2	7314	27	2500	1700	6314	27	2500	1700
			4	6320	50	4200	3200	6316	34	4500	4500
				6 - 8	4500	4500					
	355 J/H	5809/10	2	7314	27	2500	1700	6314	27	2500	1700
			4	6322	60	3600	2700	6319	45	4500	3600
						4500	4500				4500
	6 - 8	4500	4500								
	400 L/K and 400 J/H	6806/07 and 6808/09	2	7218	24	2000	1300	6218	24	2000	1300
			4	7324	72	3200	2300	6319	45	4500	3600
						4500	4500				4500
	8	4500									
	450 L/K and 450 J/H	7006/07 and 7008/09	2	7220	31	1500	1000	6220	31	1500	1000
4			7328	93	2400	1700	6322	60	4500	3500	2700
					4100	3500				4500	
8			4500	4500							

Table 35 - Lubrication intervals for cylindrical roller bearings - W50 line

	Frame		Poles	D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)		N.D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)	
	IEC	NEMA				50 Hz	60 Hz			50 Hz	60 Hz
Horizontal mounting Roller bearings	315 H/G	5009/10	4	NU320	50	4300	2900	6316	34	4500	4500
			6 - 8			4500	4500				
	355 J/H	5809/10	4	NU322	60	3500	2200	6319	45		
			6 - 8			4500	4500				
	400 L/K and 400 J/H	6806/07 and 6808/09	4	NU324	72	2900	1800	6319	45		
			6 - 8			4500	4500				
450 L/K and 450 J/H	7006/07 and 7008/09	4	NU328	93	2000	1400	6322	60			
		6			4500	3200					
8	4500										

ENGLISH

Table 36 - Lubrication intervals for deep groove ball bearings and for cylindrical roller bearings - W60 Line

	Frame		Poles	D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)		N.D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)				
	IEC	NEMA				50 Hz	60 Hz			50 Hz	60 Hz			
Horizontal mounting Ball bearings	355H/G	5810/11	2	6218	24	2300	1500	6218	24	2300	1500			
			4 - 8	6224	43	4500	4500			4500	4500			
	400J/H	L5810/11	2	6220	31	1800	1200	6220	31	1800	1200			
			4 - 8	6228	52	4500	4500			4500	4500			
	400G/F	6810/11	2	6220	31	1800	1200	6220	31	1800	1200			
			4 - 8	6228	52	4500	4500			4500	4500			
Horizontal mounting Roller bearings	355H/G	5810/11	4	NU224	43	4500	4500	6218	24	4500	4500			
			6 - 8									1500		
	400J/H	L5810/11	4	NU228	52			4500	4500		6220	31	4500	4500
			6 - 8											
	400G/F	6810/11	4	NU228	52			4500	4500		6220	31	4500	4500
			6 - 8											

Table 37 - Lubrication intervals for deep groove ball bearings and for cylindrical roller bearings - W51 HD Line

	Frame		Poles	D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)		N.D.E. Bearing	Amount of grease (g)	Lubrication intervals (hours)		
	IEC	NEMA				50 Hz	60 Hz			50 Hz	60 Hz	
Horizontal mounting Ball bearings	315	50	2	6314	27	4500	3500	6314	27	4500	3500	
			4 - 12	6320	50		4500	6316	34		4500	4500
	355	58	2	6314	27	4500	3500	6314	27	4500	3500	
			4 - 12	6322	60		4500	6319	45		4500	4500
	400	68	2	6220	24	2700	2000	6220	24	2700	2000	
			4 - 12	6324	72	4500	3800	6319	45	4500	4500	
	450	70	2	6220	31	3500	-	6220	31	3500	-	
			4	6328	93	4500	3800	6322	60	4500	4500	
	6 - 12	4500										
	Vertical mounting Ball bearings	315	50	2	7314	27	Upon request		6314	27	Upon request	
				4	7320	50	2700	2100	6316	34	4500	4200
		6 - 12	4500	4500			4500					
355		58	2	7314	27	Upon request		6314	27	Upon request		
			4	7322	60	1600	1600	6319	45	4500	3500	
6		3900	2900			4500	4500					
400		68	2	7220	24	Upon request		6220	24	Upon request		
			4	7324	72	1700	1200	6319	45	4500	3500	
6		3300	2500			4500	4500					
450		70	2	7220	31	Upon request		6220	31	Upon request		
			4	7328	93	2900	2000	6322	60	4300	3200	
6		4500	4200			4500	4500					
450	70	8 - 12	7328	93	4500	4500	6322	60	4300	3200		
		4			4500	4200						
Horizontal mounting Roller bearings	315	50	4	NU320	50	4500	4200	6316	34	4500	4500	
			6 - 12			4500	4500					
	355	58	4	NU322	60	3300	3300	6319	45	4500	4500	
			6 - 12			4500	4500					
	400	68	4	NU324	72	3500	2400	6319	45	4500	4500	
			6 - 12			4500	4500					
	450	70	4	NU328	93	1100	600	6322	60	4500	4500	
			6			2900	2000					
	450	70	8 - 12	NU328	93	4500	4500	6322	60	4500	4500	
			4			1100	600					

ENGLISH

For each increment of 15 °C above the room temperature, the relubrication intervals given in the tables must be halved. The relubrication interval of motors designed by the manufacturer for mounting in the horizontal position, but installed in the vertical position (with WEG authorization), must be halved.

For special applications, such as: high and low temperatures, aggressive environments, driven by frequency inverter (VFD – frequency inverter), etc., please contact WEG about the required amount of grease and the relubrication intervals.

8.2.1.1 Motor without grease fitting

Motors without grease fittings must be lubricated in accordance with the existing Maintenance Plan. Motor disassembly must be carried out as specified in Item 8.3. If motors are fitted with shielded or sealed bearings (for example, ZZ, DDU, 2RS, VV), these bearings must be replaced at the end of the grease service life.

8.2.1.2 Motor with grease fitting

To lubricate the bearings with the motor stopped, proceed as follows:

- Before lubricating, clean the grease nipple and immediate vicinity thoroughly;
- Lift grease inlet protection;
- Remove the grease outlet plug (not required for motors with automatic grease relief fittings, such as IEEE Std 841);
- Pump in approximately half of the total grease indicated on the motor nameplate and run the motor for about 1 (one) minute at rated speed;

- Switch-off the motor and pump in the remaining grease;
 - Lower again the grease inlet protection and reinstall the grease outlet plug.
- To grease the motor while running, proceed as follows:
- Before lubricating, clean the grease nipple and immediate vicinity thoroughly;
 - Lift grease inlet protection;
 - If safe and possible, remove the grease outlet plug;
 - Pump the total grease indicated on the motor nameplate;
 - Lower again the grease inlet protection and reinstall the grease outlet plug (if removed).



For lubrication, use an only manual grease gun.



Due to internal clearances in the motor, it is possible that, in the first re-lubrication of the bearings, the grease will not come out of the grease outlet. Therefore, do not apply excess grease expecting for it to come out.



If Motors are provided with a spring device for grease removal, the grease excess must be removed by pulling the rod and cleaning the spring until the spring does not remove more grease.

8.2.1.3 Compatibility of the Mobil Polyrex EM grease with other greases

The Mobil Polyrex EM grease has a polyurea thickener and a mineral oil and it is not compatible with other greases. If you need another type of grease, contact WEG. It is not recommended to mix different types of greases. In such a case, clean the bearings and lubrication channels before applying new grease. The used grease must have in its formulation corrosion and oxidation inhibitors.

8.2.2 Oil lubricated bearings

To change the oil of oil lubricated motor proceed as follows:

- switch-off the motor;
- remove threaded oil drain plug;
- open the valve and drain the oil;
- close the drain vale again;
- reinstall the threaded oil drain plug;
- fill-up with the type and amount of oil as specified on the nameplate;
- check the oil level. The oil level is OK when the lubricant can be viewed approximately in the center of the sight glass;
- reinstall oil inlet plug;
- check for oil leaks and ensure that all not used threaded plugs are closed with plugs.

The bearing lubricating oil must be replaced as specified on the nameplate or whenever changes in the oil properties are noticed. The oil viscosity and pH must be checked periodically. The oil level must be checked every day and must be kept in the center of the sight glass.

Please contact WEG, when oils with different viscosities should be used.

Note:

The HGF vertical mounted motors with high axial thrust are supplied with grease lubricated DE-bearings and with oil lubricated NDE-bearings. The DE-bearings must be lubricated according to recommendations in item 8.2.1. Table 38 specifies the oil type and the amount of oil required for this motor lubrication.

Table 38 - Oil properties for HGF vertical mounted motors with high axial thrust

Mounting - High axial thrust	Frame		Poles	Bearing designation	Oil (liters)	Interval (h)	Lubricant	Lubricant specification
	IEC	NEMA						
	315L/A/B and 315C/D/E	5006/7/8T and 5009/10/11T	4 - 8	29320	20	8000	Renolin DTA 40 / SHC 629	ISO VG150 mineral oil with antifoam and antioxidant additives
	355L/A/B and 355C/D/E	5807/8/9T and 5810/11/12T	4 - 8	29320	26			
	400L/A/B and 400C/D/E	6806/7/8T and 6809/10/11T	4 - 8	29320	37			
	450	7006/10	4 - 8	29320	45			

8.2.3 Oil mist lubricated bearings

Check the service conditions of the seals and if the replacement is required to use only original components. Clean the seal components before assembly (bearing caps, end shields, etc.). Apply joint sealant between the bearing caps and end shields. The joint sealant must be compatible with the used lubricating oil. Connect the oil lubricant tubes (oil inlet and oil outlet tubes and motor drain tube), as shown in Figure 41.

8.2.4 Sleeve bearings

The lubricating oil of sleeve bearings must be changed at the intervals specified in Table 39. To replace the oil, proceed as follows:

- NDE-bearing: remove the protection plate from the fan cover;
- Drain the oil through the drain hole located at the bottom of the bearing (see Figure 50);
- Close the oil drain hole;
- Remove the oil inlet plug;
- Fill the sleeve bearing with the specified oil and with the amount of oil specified in the Table 41;
- Check the oil level and ensure it is kept close to the center of the sight glass;
- Install the oil inlet plug;
- Check for oil leaks.

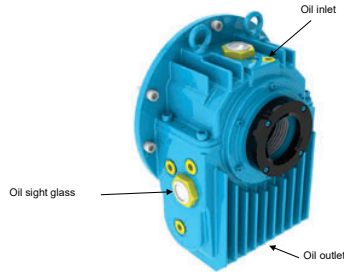


Figure 50 - Sleeve bearing

Table 39 - Oil properties for sleeve bearings.

Frame		Poles	Bearing designation	Oil (liters)	Interval (h)	Lubricant	Lubricant Specification
IEC	NEMA						
315L/A/B and 315C/D/E	5006/7/8T and 5009/10/11T	2	9-80	3.6	8000	Renolin DTA 10	ISO VG32 mineral oil with antifoam and antioxidant additives
355L/A/B and 355C/D/E	5807/8/9T and 5810/11/12T						
400L/A/B and 400C/D/E	6806/7/8 and 6809/10/11T						
450	7006/10						
315L/A/B and 315C/D/E	5006/7/8T and 5009/10/11T	4 - 8	9-90	4.7	8000	Renolin DTA 15	ISO VG46 mineral oil with antifoam and antioxidant additives
355L/A/B and 355C/D/E	5807/8/9T and 5810/11/12T		9-100				
400L/A/B and 400C/D/E	6806/7/8 and 6809/10/11T		11-110				
450	7006/10		11-125				
500	8006/10						

The lubricating oil must be replaced as specified on the nameplate or whenever changes on the oil properties are noticed. The oil viscosity and pH must be checked periodically. The oil level must be checked every day and kept in the center of the sight glass.

Please contact WEG, when oils with different viscosities are to be used.

8.3 MOTOR ASSEMBLY AND DISASSEMBLY



All repair services on motors for use in hazardous areas should be always performed by qualified personnel and in accordance with the applicable laws and regulations in each country. Always use proper tools and devices for motor disassembly and assembly.



Disassembly and assembly services can be carried out only after the motor has been disconnected from the power supply and is completely stopped. Dangerous voltages may be present at the motor terminals inside the terminal box since capacitors can retain electrical charge for long periods of time even when they are not connected directly to a power source or when space heaters are connected to the motor or when the motor windings are used as space heaters. Dangerous voltages may be present at the motor terminals when they are driven by frequency inverter even when they are completely stopped.



For explosion-proof motors and protection by enclosure motors, open the terminal box and/or disassemble the motor only after the enclosure surface temperature has cooled down up to ambient temperature.

Record the installation conditions such as terminal connection diagram, alignment/leveling conditions before starting the disassembly procedures. These records should be considered for later assembly.

Disassemble the motor carefully without causing scratches on machined surfaces or damaging the threads. Assemble the motor on a flat surface ensuring a good support base. Footless motors must be fixed/locked on the base to prevent accidents.

Handle the motor carefully to not damage the insulated components such as windings, insulated rolling bearings, power cables etc.


Seal elements, such as joint seals and bearing seals should always be replaced when wear or damage is noticed. For motors with a degree of protection higher than IP55, the machined joints are protected at the factory by a suitable rust inhibitor. Thus all machined surfaces (for example, covers of the terminal boxes of explosion-proof motors) must be carefully cleaned before assembly and provided again by a thin coat of rust inhibitor as shown in Figure 51.



For explosion-proof motors, the joints can be coated only with the following products:

- Lumomoly PT/4 (Lumobras);
- Molykote DC 33 (Dow Corning).

For other types of protection, apply Loctite 5923 (Henkel) on the joints.



Apply rust inhibitor on all machined surfaces of the motors with a degree of protection higher than IP55.

Figure 51 - Machined surface of the terminal box of explosion-proof motors.

If it is necessary to replace a fastener, the quality and dimensions of the fastener must be maintained. For explosion-proof motors, fasteners must have a tensile strength equal to or greater than class 12.9 for carbon steel material and class A2-70 or A4-70 for stainless steel material, and the replacement of a stud-type fastener requires the application of threadlocker (Tekbond 116, Almax A3221, Almax A3241, Loctite 243 or Loctite 263) on the tip (interface with the housing) and on the locking nut of the stud.

For explosion-proof motors special care should be taken with the machined surfaces of the flame path. These surfaces must be free of burrs, scratches, etc. that reduce the flame path length and increase the gap.

The gaps between terminal boxes and the respective terminal box covers should not exceed the values specified in Table 40.

Table 40 - Maximum gap between terminal box and the terminal box cover for explosion-proof enclosures.

Product line	Frame	Plane gasket		Cylindrical gasket	
		Folga (máx.)	Length (min.)	Folga (máx.)	Length (min.)
W21Xdb	IEC 90 a 355 NEMA 143 a 586/7	0,05 mm	Upon request	Not available	
W22Xdb	IEC 71 a 80	Not available		0,15 mm	12,5 mm
	IEC 90 a 355 NEMA 143 a 586/7	0,075 mm	6 mm	0,15 mm	19 mm

For the W40, W50, HGF and W51 HD motor lines provided with axial fans, the motor and the axial fan have different markings for indicating the direction of rotation for prevent incorrect assembly. The axial fan must be assembled so that the indicative arrow for direction of rotation is always visible, viewing the non-drive end side. The marking indicated on the axial fan blade, CW for clockwise direction of rotation or CCW for counterclockwise direction of rotation, indicates the direction of rotation of the motor viewing the drive end side.

For motors with permanent magnet rotor (lines WQuattro and Magnet), the motor assembly and disassembly require the use of proper devices due to the attracting or repelling forces that occur between metallic parts. This work must only be performed by a WEG Authorized service center specifically trained for such an operation. People with pacemakers cannot handle these motors. The permanent magnets can also cause disturbances or damages to other electric equipment and components during maintenance.

8.3.1 Terminal box

Proceed as follows to remove the terminal box cover and to disconnect/connect the power supply cables and the cables of the accessory devices:

- Ensure that during the screw removal the terminal box cover does not damage the components installed inside the terminal box.
- If the terminal box cover is fitted with lifting eyebolt, lift the terminal box cover always by its lift eyebolt.
- If motors are supplied with terminal blocks, ensure the correct tightening torque on the motor terminals as specified in Table 41.



For flying leads motors, do not push the overlength of leads into the motor in order to prevent that they touch the rotor.

- Ensure that the cables do not contact sharp edges.
- Ensure that the original IP degree of protection is not changed and is maintained as indicated on the motor nameplate. The power supply cables and the control cables must always be fitted with components (cable glands, conduits) that meet the applicable standards and regulations of each country.

- Ensure that the pressure relief device is in perfect operating condition if provided. The seals in the terminal box must be in perfect condition for reuse and must be reinstalled correctly to ensure the specified degree of protection.
- Ensure the correct tightening torque for the securing bolts, cable-glands and plugs as specified in Table 41 and Table 42.

Table 41 - Tightening torque for the securing bolts [Nm]

Screw type and seal		M4	M5	M6	M8	M10	M12	M14	M16	M20
Hex bolt/hex socket bolt (rigid seal)		-	3,5 to 5	6 to 9	14 to 20	28 to 40	45 to 70	75 to 110	115 to 170	230 to 330
Combined slotted screw (rigid seal)		1,5 to 3	3 to 5	5 to 10	10 to 18	-	-	-	-	-
Hex bolt/hex socket bolt (Flexible seal)		-	3 to 5	4 to 8	8 to 15	18 to 30	25 to 40	30 to 45	35 to 50	-
Combined slotted screw (Flexible seal)		-	3 to 5	4 to 8	8 to 15	-	-	-	-	-
Terminal blocks		1 to 1,5	2 to 4 ¹⁾	4 to 6,5	6,5 to 9	10 to 18	15,5 to 30	-	30 to 50	50 to 75
Grounding terminals		1,5 to 3	3 to 5	5 to 10	10 to 18	28 to 40	45 to 70	-	115 to 170	-
Terminal box cover	Explosion-proof motors	-	-	-	35 to 41	69 to 83	120 to 145	-	295 to 355	580 to 690
	Other types of protection	-	3 to 5	4 to 8	8 to 15	25 to 37	40 to 55	-	50 to 65	-

Note: 1) For 12-pin terminal block, apply the minimum torque of 1.5 Nm and maximum torque of 2.5 Nm.

Table 42 - Tightening torques for cable glands and plugs [Nm]

Thread	Material	M16	M20	M25	M32	M40	M50	M63	M80
Metric	Plastic	3 to 5	3 to 5	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8
	Metallic	40 to 50	40 to 50	55 to 70	65 to 80	80 to 100	100 to 120	115 to 140	160 to 190
Thread	Material	NPT 1/2"	NPT 3/4"	NPT 1"	NPT 1 1/2"	NPT 2"	NPT 2 1/2"	NPT 3"	NPT 4"
	Material	-	5 to 6	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8
NPT	Plastic	-	5 to 6	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8	6 to 8
	Metallic	40 to 50	40 to 50	55 to 70	65 to 80	100 to 120	115 to 140	150 to 175	200 to 240

8.4 DRYING THE STATOR WINDING INSULATION

Dismantle the motor completely. Remove the end shields, the rotor with the shaft, the fan cover, the fan and the terminal box before the wound stator with the frame is transferred to the oven for the drying process. Place the wound stator in the oven heated to max. 120 °C for two hours. For larger motors a longer drying time may be required. After the drying process has been concluded, allow the stator to cool to room temperature. Measure the insulation resistance again as described in item 5.4. Repeat the stator drying process if the required insulation resistance does not meet the values specified in Table 8. If the insulation resistance does not improve despite several drying processes, evaluate the causes of the insulation resistance drop carefully and an eventual replacement of the motor winding may be required. If in doubt contact WEG.



To prevent electrical shock, discharge the motor terminals immediately before, and after each measurement. If the motor is equipped with capacitors, these must be discharged before beginning any repair.




Pacemaker users and unqualified personnel shall not open Magnet and WQuattro motors, because high energy magnets are used.

8.5 SPARE PARTS

When ordering spare parts, always provide complete motor designation, indicating the motor type, the code number and the serial number, which are stated on the motor nameplate.

Spare parts must always be purchased from WEG authorized Service Centers. The use of non-original spare parts can cause motor failure, performance drop and void the product warranty.

The spare parts must be stored in a clean, dry and properly ventilated room, with relative air humidity not exceeding 60%, with an ambient temperature between 5 °C and 40 °C, free of dust, vibrations, gases, corrosive smokes and at a constant temperature. The spare parts must be stored in their normal mounting position without placing other components onto them.

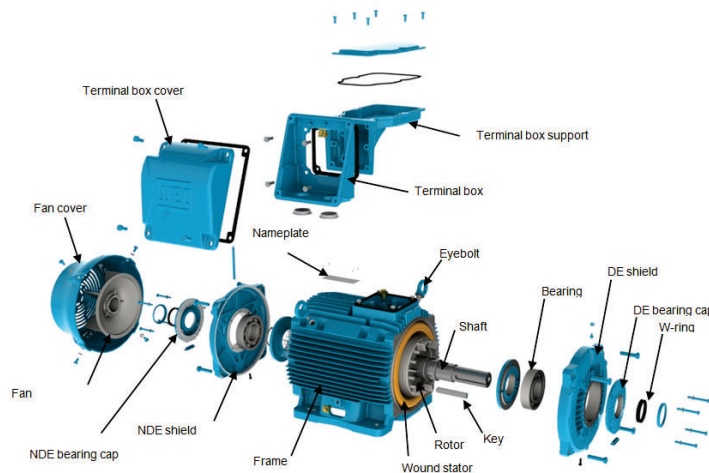

Exploded view of the components of a motor with the type of protection "ec".

9. ENVIRONMENTAL INFORMATION

Disposal and environmental information of electric motors are available in document 14519468 at www.weg.net.

10. TROUBLESHOOTING CHART X SOLUTIONS

This troubleshooting chart provides a basic list of problems that may occur during motor operation, possible causes and recommended corrective actions. In case of doubts, please contact WEG Service Center.

Table 43 - Troubleshooting chart x solutions

Problem	Possible cause	Corrective action
The motor does not start, neither coupled nor decoupled	Power cables are interrupted.	Check the control panel and the motor power supply cables.
	Blown fuses.	Replace blown fuses.
	Wrong motor connection.	Correct the motor connection according to the connection diagram.
	Locked rotor.	Check the motor shaft to ensure that it rotates freely.
The motor starts at no-load but fails when the load is applied. It starts very slowly and does not reach the rated speed.	Load torque is too high during start-up.	Do not start the motor on load.
	Too high voltage drop in the power cables	Check the installation dimensioning (transformer, cable cross section, relays, circuit breakers, etc.)
Abnormal/excessive noise	Defective transmission component or defective driven machine.	Check the transmission force, the coupling and the alignment.
	Misaligned/unleveled base.	Align/level the motor with the driven machine
	Unbalanced components or unbalanced driven machine	Balance the machine set again
	Different balancing methods used for motor and coupling balancing (half key, full key)	Balance the motor again
	The wrong motor direction of rotation	Reverse the direction of rotation
	Loose bolts	Retighten the bolts
	Foundation resonance	Check the foundation design
	Damaged bearings	Replace the bearings
Motor overheating	Insufficient cooling	Clean air inlet and outlet and cooling fins
		Check the minimum required distance between the fan cover and nearest walls. See item 7
		Check air temperature at inlet
	Overload	Measure motor current, evaluate motor application and if required, reduce the load
	Number of starts per hour is too high or the load inertia moment is too high	Reduce the number of starts per hour
	Power supply voltage too high	Check the motor power supply voltage. Power supply voltage must not exceed the tolerance specified in item 7.2
	Power supply voltage too low	Check the motor power supply voltage and the voltage drop. Power supply voltage must not exceed the tolerance specified in item 7.2
	Interrupted power supply	Check the connection of the power cables
	Voltage unbalance at the motor terminals	Check for blown fuses, wrong commands, voltage unbalance in the power line, phase fault or interrupted power cables
Direction of rotation is not compatible with the unidirectional fan	Check if the direction of rotation matches the rotation arrow indicated on end shield	
Bearing overheating	Excessive grease/oil	Clean the bearing and lubricate it according to the provided recommendations
	Grease /oil aging	
	The used grease / oil does not match the specified one	
	Lack of grease/oil	Lubricate the bearing according to the provided recommendations
	Excessive axial or radial forces due to the belt tension	Reduce the belt tension
Reduce the load applied to the motor		